



User Manual 用户手册



SRX series integrated I/O module

Modbus-TCP Protocol
Remote IO Module
Distributed IO module

CATALOGUE

1.Preface	3
1.1 Document Usage Instructions	4
1.2 Safety Precautions	4
1.3 Document History	4
1.4 Reference document	4
2.Product Overview	5
2.1 Model List (Naming Rules)	6
2.2 SRX-MT specification parameters	10
2.2.1 16DI specification	10
2.2.2 16 DQ specifications	10
2.2.3 8DI / 8 DQ specifications	11
2.2.4 6AI specifications	12
2.2.5 4 AQ specification	12
2.2.6 8 RTD specification	13
2.2.7 8TC specification	13
2.2.8 Modbus-TCP Communication Specification	14
2.2.9 Power supply specification	14
3. Structure description	15
3.1 Shell	16
3.2 Installation Method	16
4.Hardware description	17
4.1 SRX-MT Structure Diagram 16 Points	18
4.2 SRX-MT Structure Diagram 32 Points	19
4.3 Communication interface	20
4.4 LED indication	20
4.4.1 System status indicates the working condition of the system.	20
4.4.2 I/O Status Indication	20
4.4.3 RJ45 indicator light	21
4.5 Communication power supply	21
4.6 Dial switch	22
4.7 Module terminal wiring diagram	23
4.7.1 Wiring diagram of the digital quantity module	23
4.7.2 Wiring diagram of the analog quantity module	33
4.7.3 Wiring diagram of the temperature module	37
4.7.4 4-20mA definition and line graph	40
5.Modbus-TCP Protocol	41
5.1 Modbus-TCP Industrial Ethernet Protocol	42
5.1.1 What is Modbus-TCP ?	42
5.2 Network topology	42
5.2.1 Star network	42
5.2.2 Daisy-chain network	43
5.2.3 Tree-shaped network	43
5.3 SRX-MT Address Mapping	43
5.4 Module Parameters	43
6.Communication connection with PLC	54



1.Preface

1.1 Document Usage Instructions

This document describes the product's functional specifications, installation, operation and settings, as well as the content related to network protocols. This document is only applicable for trained electrical automation engineers.

(1) Disclaimer

The author has conducted necessary checks on the document, but as the product evolves and develops, the document may contain technical parameters or editing errors. We reserve the right to make adjustments and modifications without prior notice to users.

(2) Trademark

MODBUS/TCP is a derivative product of the simple, neutral manufacturer's MODBUS series communication protocols used for managing and controlling automation equipment. It covers the use of MODBUS messages in "Intranet" and "Internet" environments using the TCP/IP protocol.

(3) Patent Information

The designer of this product has applied for patent protection for the appearance and technical implementation methods of the product. Any attempts to copy, imitate or reverse engineer may violate the law.

(4) Copyright

Without the author's authorization, it is prohibited to copy, distribute and use this document.

1.2 Safety Precautions

This product is a professional equipment for industrial use and can only be operated by personnel with electrical operation experience. Before use, please carefully read this manual and follow the instructions to operate it. Failure to do so may result in personal injury or product damage.

This product is designed with an IP20 protection level. When using it, it needs to be installed in a distribution cabinet with dust-proof and moisture-proof functions.

1.3 Document History

Release	date	description
V1.0	2021.11.03	Initial release
V1.1	2022.03.22	Added analog module
V1.2	2024.12.30	Newly added 8DI8DO, 8RTD, 8TC specification parameters

1.4 Reference document

《IEC11631-22007 Programmable controllers –Part 2:Equipment requirements and tests》；

《IEC/TR 61158 Industrial Communication Network - Fieldbus Specification》；

《IEC61784-1 Industrial Communication Network - Industry Standards Part 1: Fieldbus Standards》；



2.Product Overview

2.1 Model List (Naming Rules)

The SRX-MT series of remote I/O products support the standard Modbus-TCP communication protocol. Through the digital, analog and temperature functions integrated in the module body, they do not require any other Modbus-TCP bus couplers.

Naming rules for digital and analog modules

S R X - D 1 6 1 6 P - M T

Serial prefix	Module type	Input point/output point	Output type	Communication protocol
integrated - Prefix meaning - Super Remote IO X represents the flexibility of this module, which can currently achieve 288 combinations.			P:PNP output N:NPN output Note: This character is only Quantity input in contained numbers Enable when out, simulate The volume module does not enable this Characters.	PN:PROFINET(Ethernet) EP:EtherNet/IP(Ethernet) CE:CC-Link IE FB(Ethernet) EA:EtherCAT MT:Modbus TCP(Ethernet) RTU:Modbus RTU(RS485)
	D: numeric quantity	1600: Number 16 in /0 out 3200: number 32 in /0 out 0016: digits 0 in /16 out 0032: indicates the number 0 in /32 out 0808: digits 8 in /8 out 1616: Number 16 in /16 out 2408: digital quantity 24 in /8 out 0824: digits 8 in /24 out		
	A: Analog quantity	0600: Analog 6 input 1200: Analog 12 in 0004: Analog output 4 0008: Analog output 8 0604: Analog 6 in /4 out		

How to distinguish the type of numeric input point?

- ① When the input point is 16DI, the PNP&NPN input is also supported
- ② When the input point is 8DI, only one input mode is supported, and the type is the same as that of the output point
- ③ When the input point is 24DI, 16 DI supports PNP&NPN input at the same time, and 8 DI supports only one input mode with the same type as the output point
- ④ Analog models can support both current and voltage signal types

Naming rules for mixed digital and analog modules

S R X - M 8 8 6 0 P - M T

Serial prefix	Module type	Digital input/digital output	Analog input/analog output	Numeric output type	Communication protocol
integrated - Prefix meaning - Super Remote IO X represents the flexibility of this module, which can currently achieve 288 combinations.	M: Mixed digital and analog Mixed Module	88:8DI/8DO 0F: No input /16DO F0:16DI/ None Output	60:6AI/ No output 04: No input /4AO	P:PNP output N:NPN output	PN:PROFINET(Ethernet) EP:EtherNet/IP(Ethernet) CE:CC-Link IE FB(Ethernet) EA:EtherCAT MT:Modbus TCP(Ethernet) RTU:Modbus RTU(RS485)

How to distinguish numeric input point types?

- ① When the input point is 16DI, the PNP&NPN input is also supported
- ② When the input point is 8DI, only one input mode is supported, and the type is the same as that of the digital output point

How to distinguish analog input/output types?

- AI: Analog inputs are both current and voltage mixed
AO: Analog output is current and voltage mixed type

Naming rules for the temperature acquisition module

SRX - 08RTD - MT

Serial prefix	Number of channels	Collection type	Communication protocol
integrated		RTD: thermal resistance	PN:PROFINET(Ethernet)
- Prefix meaning -	08:8 channel	TC: thermocouple	EP:EtherNet/IP(Ethernet)
Super Remote IO	16:16 channel		CE:CC-Link IE FB(Ethernet)
X represents the flexibility of this module, which can currently achieve 288 combinations.			EA:EtherCAT
			MT:Modbus TCP(Ethernet)
			RTU:Modbus RTU(RS485)

Thermistor and thermocouple hybrid module model: SRX-8RTD-8TC-**

Temperature acquisition and other functions of the mixed module naming rules

SRX - 88DP - 8RTD - MT

Serial prefix	Slot 1 Functions	Slot 2 Functions	Communication protocol
integrated	88DP:8DI/8DO,PNP input,PNP output	8RTD: 8-channel thermal resistance	PN:PROFINET(Ethernet)
- Prefix meaning -	88DN:8DI/8DO,NPN input and NPN output	8TC: 8-channel thermocouple	EP:EtherNet/IP(Ethernet)
Super Remote IO	16DI: indicates the 16DI and PNP&NPN input		CE:CC-Link IE FB(Ethernet)
X represents the flexibility of this module, which can currently achieve 288 combinations.	16DOP:16DO,PNP output		EA:EtherCAT
	16DON:16DO,NPN output		MT:Modbus TCP(Ethernet)
	6AI:6AI, current and voltage hybrid input		RTU:Modbus RTU(RS485)
	4AO:4AO, mixed current and voltage output		

class	number of order	Specification description
Digital quantity input / output	SRX-D0808P-MT	Supports Modbus TCP protocol, dual network ports, 8DI_PNP, 8DO_PNP, transistors, 24VDC, 0.5A
	SRX-D0808N-MT	Supports Modbus TCP protocol, dual network ports, 8DI_NPN, 8DO_NPN, transistors, 24VDC, 0.5A
	SRX-D1616P-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 16DO_PNP, transistors, 24VDC, 0.5A
	SRX-D1616N-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 16DO_NPN, transistors, 24VDC, 0.5A
	SRX-D2408P-MT	Supports Modbus TCP protocol, dual network ports, 24DI_PNP, 8DO_PNP, transistors, 24VDC, 0.5A
	SRX-D2408N-MT	Supports Modbus TCP protocol, dual network ports, 24DI_NPN, 8DO_NPN, transistors, 24VDC, 0.5A
	SRX-D0824P-MT	Supports Modbus TCP protocol, dual network ports, 8DI_PNP, 24DO_PNP, transistors, 24VDC, 0.5A
	SRX-D0824N-MT	Supports Modbus TCP protocol, dual network ports, 8DI_NPN, 24DO_NPN, transistors, 24VDC, 0.5A
Digital input	SRX-D1600-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 24VDC
	SRX-D3200-MT	Supports Modbus TCP protocol, dual network ports, 32DI_PNP&NPN, 24VDC
Digital output	SRX-D0016P-MT	Supports Modbus TCP protocol, dual network ports, 8DI_PNP, 8DO_PNP, transistors, 24VDC, 0.5A
	SRX-D0016N-MT	Supports Modbus TCP protocol, dual network ports, 8DI_NPN, 8DO_NPN, transistors, 24VDC, 0.5A
	SRX-D0032P-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 16DO_PNP, transistors, 24VDC, 0.5A
	SRX-D0032N-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 16DO_NPN, transistors, 24VDC, 0.5A
analog quantity	SRX-A0600-MT	Supports Modbus TCP protocol, dual network interfaces, 6AI, U/I, 16bit, 24VDC
	SRX-A1200-MT	Supports Modbus TCP protocol, dual network interfaces, 12AI, U/I, 16bit, 24VDC
	SRX-A0004-MT	Supports Modbus TCP protocol, dual network interfaces, 4AO, U/I, 16bit, 24VDC
	SRX-A0008-MT	Supports Modbus TCP protocol, dual network interfaces, 8AO, U/I, 16bit, 24VDC
	SRX-A0604-MT	Supports Modbus TCP protocol, dual network interfaces, 6AI, 4AO, U/I, 16bit, 24VDC
Temperature collection	SRX-08RTD-MT	Supports Modbus TCP protocol, dual network interfaces, 8RTD (thermal resistance), 16bit, 24VDC, three-wire/ two-wire
	SRX-16RTD-MT	Supports Modbus TCP protocol, dual network interfaces, 16RTD (thermal resistance), 16bit, 24VDC, three-wire/ two-wire
	SRX-08TC-MT	Supports Modbus TCP protocol, dual network interfaces, 8TC (thermal couple), 16bit, 24VDC, two-wire
	SRX-16TC-MT	Supports Modbus TCP protocol, dual network interfaces, 16TC (thermal couple), 16bit, 24VDC, two-wire
	SRX-8RTD-8TC-MT	Supports Modbus TCP protocol, dual network interfaces, 8RTD (thermal resistance), 8TC (thermal couple), 16bit, 24VDC
	SRX-M8860P-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_PNP,

Hybrid module		transistor, 0.5A, 6AI, U/I, 16bit, 24VDC
	SRX-M8860N-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_NPN, transistor, 0.5A, 6AI, U/I, 16bit, 24VDC
	SRX-M8804P-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_PNP, transistor, 0.5A, 4AO, U/I, 16bit, 24VDC
	SRX-M8804N-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_NPN, transistor, 0.5A, 4AO, U/I, 16bit, 24VDC
	SRX-MF060-MT	Supports Modbus TCP protocol, dual network interfaces, 16DI_PNP&NPN, 6AI, U/I, 16bit, 24VDC
	SRX-MF004-MT	Supports Modbus TCP protocol, dual network interfaces, 16DI, 4AO, U/I, 16bit, 24VDC
	SRX-M0F60P-MT	Supports Modbus TCP protocol, dual network interfaces, 16DO_PNP, transistor, 0.5A, 6AI, U/I, 16bit, 24VDC
	SRX-M0F60N-MT	Supports Modbus TCP protocol, dual network interfaces, 16DO_NPN, transistor, 0.5A, 6AI, U/I, 16bit, 24VDC
	SRX-M0F04P-MT	Supports Modbus TCP protocol, dual network interfaces, 16DO_PNP, transistor, 0.5A, 4AO, U/I, 16bit, 24VDC
	SRX-M0F04N-MT	Supports Modbus TCP protocol, dual network interfaces, 16DO_NPN, transistor, 0.5A, 4AO, U/I, 16bit, 24VDC
	SRX-88DP-8RTD-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_PNP, 0.5A, 8RTD (thermal resistance), 16bit, 24VDC
	SRX-88DN-8RTD-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_NPN, 0.5A, 8RTD (thermal resistance), 16bit, 24VDC
	SRX-88DP-8TC-MT	Supports Modbus TCP protocol, dual network interfaces, 8DI8DO_PNP, 0.5A, 8TC (thermal couple), 16bit, 24VDC Supports Modbus TCP protocol, dual network ports, 8DI8DO_NPN, 0.5A, 8TC (thermocouple), 16bit, 24VDC
	SRX-88DN-8TC-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 8RTD (thermoresistor), 16bit, 24VDC
	SRX-16DI-8RTD-MT	Supports Modbus TCP protocol, dual network ports, 16DI_PNP&NPN, 8TC (thermocouple), 16bit, 24VDC
	SRX-16DI-8TC-MT	Supports Modbus TCP protocol, dual network ports, 16DO_PNP, 0.5A, 8RTD (thermoresistor), 16bit, 24VDC
	SRX-16DOP-8RTD-MT	Supports Modbus TCP protocol, dual network ports, 16DO_NPN, 0.5A, 8RTD (thermoresistor), 16bit, 24VDC
	SRX-16DON-8RTD-MT	Supports Modbus TCP protocol, dual network ports, 16DO_PNP, transistor, 0.5A, 8TC (thermocouple), 16bit, 24VDC
	SRX-16DOP-8TC-MT	Supports Modbus TCP protocol, dual network ports, 16DO_NPN, transistor, 0.5A, 8TC (thermocouple), 16bit, 24VDC
	SRX-16DON-8TC-MT	Supports Modbus TCP protocol, dual network ports, 6AI, U/I, 8RTD (thermoresistor), 16bit, 24VDC
	SRX-6AI-8RTD-MT	Supports Modbus TCP protocol, dual network ports, 4AO, U/I, 8RTD (thermoresistor), 16bit, 16bit, 24VDC
	SRX-4AO-8RTD-MT	Supports Modbus TCP protocol, dual network ports, 6AI, U/I, 8TC (thermocouple), 16bit, 24VDC
	SRX-6AI-8TC-MT	Supports Modbus TCP protocol, dual network ports, 4AO, U/I, 8TC (thermocouple), 16bit, 24VDC
	SRX-4AO-8TC-MT	Supports Modbus TCP protocol, dual network interfaces, 6AI, U/I, 16bit, 24VDC

2.2 SRX-MT specification parameters

2.2.1 16DI specification

The 16-point digital input (DI) specification parameters are shown in Table 2.

order number	project	specifications
1	number of channels	16
2	access type	2 bytes
3	Ton	Type. 18uS / Max. 35uS
4	Toff	Type. 135uS / Max. 250uS
5	Enter the type	Source or leakage type
6	Enter the connector	Plug-in connector
7	Rated input voltage	24 V DC (-15 %/+20 %), (IEC 61131-2, type 2)
8	The "0" signal level	-3...+5 V (IEC 61131-2, type 2)
9	The "1" signal level	15...30 V (IEC 61131-2, type 2)
10	input currenton	Typ. 10mA/Ch (IEC 61131-2, type 2)
11	Electrical isolation	Input / control area: 500V DC

Table 2 Digital quantity input specifications

2.2.2 16 DQ specifications

The 16-point digital output (DQ) specification parameters are shown in Table 3.

order number	project	specifications
1	number of channels	16
2	access type	2 bytes
3	Ton	Type. 12uS / Max. 25uS
4	Toff	Type. 10 mS / Max. 20 mS (empty load)
5	Output type	Source or leakage type
6	Output connector	Plug-in connector
7	loadtype	Pure resistance, sensibility, the light bulb
8	Rated output voltage	24 V DC (-15 %/+20 %), (IEC 61131-2, type 2)
9	maximum output current	Max. 0.5 A / Ch, independent short-circuit protection for each channel
10	Rated total output current	8A

Table 3 Digital quantity output specifications

2.2.3 8DI / 8 DQ specifications

Number 8 input / 8 output (DI / DQ) Specification parameters are shown in 4.

input specification		
order number	project	specifications
1	number of channels	16
2	access type	2 bytes
3	Ton	Type. 18uS / Max. 35uS
4	Toff	Type. 135uS / Max. 250uS
5	Enter the type	Source or leakage type
6	Enter the connector	Plug-in connector
7	Rated input voltage	24 V DC (-15 %/+20 %), (IEC 61131-2, type 2)
8	The "0" signal level	-3...+5 V (IEC 61131-2, type 2)
9	The "1" signal level	15...30 V (IEC 61131-2, type 2)
10	input currenton	Typ. 10mA/Ch (IEC 61131-2, type 2)
11	Electrical isolation	Input / control area: 500V DC
Output specifications		
order number	project	specifications
1	number of channels	8
2	access type	2 bytes
3	Ton	Type. 12uS / Max. 25uS
4	Toff	Type. 10 mS / Max. 20 mS (empty load)
5	Output type	Source or leakage type
6	Output connector	Plug-in connector
7	loadtype	Pure resistance, sensibility, the light bulb
8	Rated output voltage	24 V DC (-15 %/+20 %), (IEC 61131-2, type 2)
9	maximum output current	Max. 0.5 A / Ch, independent short-circuit protection for each channel
10	Rated total output current	8A

Table 4 Digital quantity output specifications

2.2.4 6AI specifications

The 6-channel analog volume input (AI) specification parameters are shown in Table 5.

order number	project	specifications
1	number of channels	6
2	access type	12 bytes
3	Enter the type	Voltage type / current type
4	resolution ratio	16 bits (with symbols)
5	Sampling range	0~10V,0~20mA,4~20mA
6	Enter the connector	Plug-in connector
7	input impedance	Current sampling: 124.5 Ω , voltage sampling: 10 M Ω
8	sampling error	< $\pm$ 0.3% (full range)
9	sample rate	Greater than 1 k SPS / ch
10	Software filtering	Available software configuration (TIA Botu)

Table 5 Analog input (AI) specifications

2.2.5 4 AQ specification

The 4-channel analog output (AQ) specification parameters are shown in Table 6.

order number	project	specifications
1	number of channels	4
2	access type	8 bytes
3	Enter the type	Voltage type / current type
4	resolution ratio	16 bits (with symbols)
5	Sampling range	0~10V,0~20mA,4~20mA
6	Output connector	Plug-in connector
7	load	The current output is 500 Ω , and the voltage output is 1 K Ω
8	sampling error	< $\pm$ 0.3% (full range)
9	conversion rate	Greater than 1 k SPS / ch
10	Software filtering	Available software configuration (TIA Botu)

Table 6 Analog output (AQ) specifications

2.2.6 8 RTD specification

The channel thermal resistance input (RTD) specification parameters are shown in Table 7.

order number	project	specifications
1	number of channels	8 CH (two-wire system or three-wire system)
2	access type	16 Bytes or 8 words
3	Enter the type	PT100,Cu50
4	temperature range	-200°C ~ + 850°C (PT sensor), -60°C ~ + 250°C (Ni sensor)
5	presentation of information	0.1°C per channel bit
6	sampling error	Less than $\pm 0.3\%$ (full range)
7	sample rate	2ms
8	Filter time	Configuration

Table 7 Thermal resistance input (RTD) specifications

2.2.7 8TC specification

The 8-channel thermocouple input (TC) specification parameters are shown in Table 8.

order number	project	specifications
1	number of channels	8 CH (two-wire system)
2	access type	16 Bytes or 8 words
3	Enter the type	Type J / K / E / T / S / R / B / N thermocouples
4	presentation of information	0.1°C per channel bit
5	sampling error	Less than $\pm 0.3\%$ (full range)
6	sample rate	2ms
7	Filter time	Configuration
8	survey measure pattern Around °C	Type K form-270 to 1370°C
9		S type – 50 to 1760°C
10		R type-50 to 1760°C
11		Type B forms ranged from 0 to 1820°C
12		Type J-210 to 1200°C
13		Type N-270 to 1300°C
14		Type E – 270 to 1,000°C
15		T type-270 to 400°C
16	data format	16-bit signed integer (Integer)

Table 8 Thermal resistance input (RTD) specifications

2.2.8 Modbus-TCP Communication Specification

The Modbus-TCP communication specification parameters are shown in Table 5.

Order number	project	specifications
1	Agreement	Modbus-TCP
2	Transmission rate	10/100 Mbaud, automatically detects transmission speed
3	Bus interface	Equipped with dual RJ45 switches, compliant with IEEE 802.xx standard for industrial Ethernet, featuring auto negotiation and auto crossover functions
4	Communication address	The only globally unique MAC address
5	Transmission cable	CAT5e shielded cable
6	ETHERNET/IP features	Media redundancy protocol (MRP), shared devices, synchronous communication
7	Port protection	Transformer isolation, 1500V DC (IEC61000-4-2)

Table 6 Modbus-TCP Communication Specifications

2.2.9 Power supply specification

The module power supply is divided into three independent parts: the control part, the digital input part, and the MOSFET digital output part, which are isolated from each other. Therefore, three separate power supplies need to be provided for each part of the circuit or they can be directly connected in parallel.

The control voltage uses 24V DC (-15% / +20%), with a maximum current consumption of 0.5A, and has polarity reverse protection; the electrical isolation withstand voltage between it and other I/O components is 500V DC.

② The input voltage for digital quantity is 24V DC (-15% +/20%), with a maximum current consumption of 16*10mA; the electrical isolation withstand voltage between this part and other I/O components is 500V DC.

③ The digital output section of the MOSFET uses 24V DC (-15% +/20%), with a maximum current consumption of 16 * 0.5A, and has independent overcurrent protection for each channel. The electrical isolation withstand voltage between this section and other I/O sections is 500V DC.



3. Structure description

3.1 Shell

The SRX series modules are made of industrial plastic. Their dimensions are: 33 * 122.5 * 90.5 (W/H/D, mm).

The protection level is IP20, suitable for installation inside the cabinet.

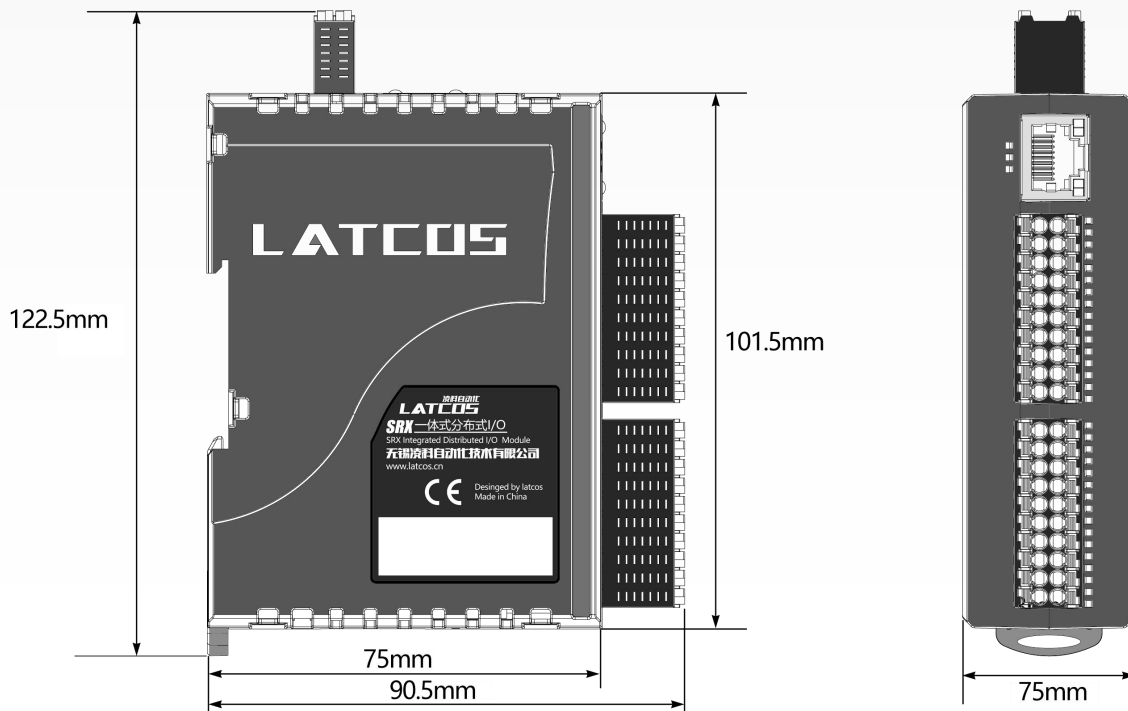


Figure 1 Module size diagram

3.2 Installation Method

The design of the SRX series modules adopts natural convection cooling. At least 25 mm of space must be left above and below to facilitate normal heat dissipation. The distance between the front panel and the back panel should also be maintained at least 75 mm.

The modules can be easily installed on a standard DIN rail, with the rail specification being TS35/7.5, as shown in Figure 2.



Figure 2 SRX series installation diagram



4. Hardware description

4.1 SRX-MT Structure Diagram 16 Points

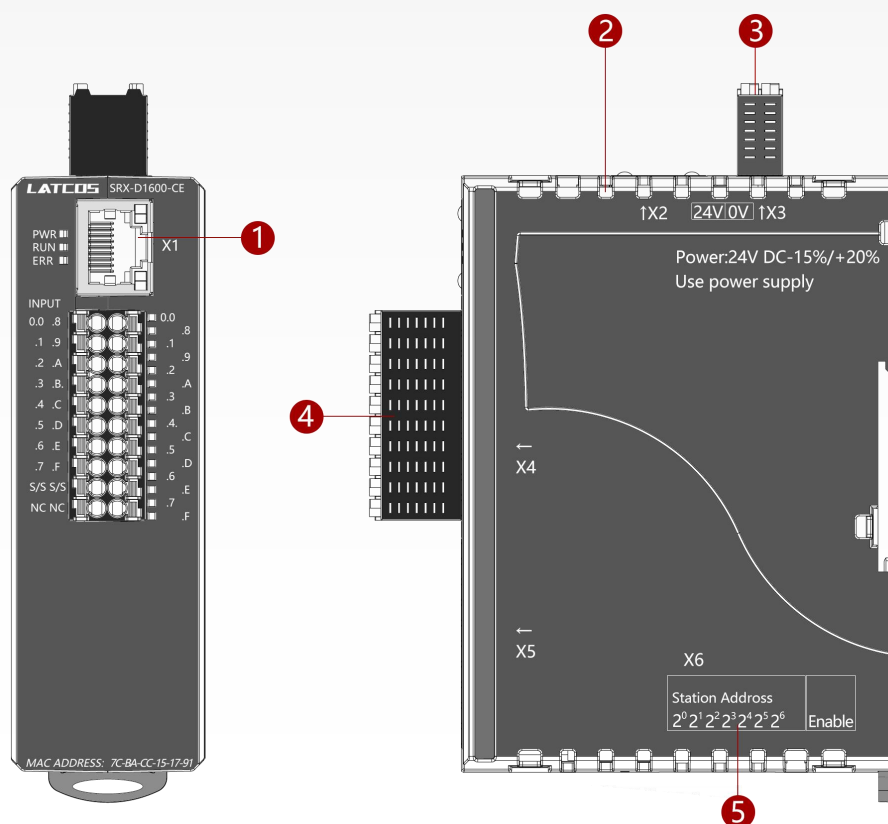


Figure 3 Module Wiring Diagram

order number	characteristic	The interface name	function definition
①	X1	RJ45 port	Ethernet interface, connecting to PLC or PC end
②	X2	RJ45 port	Ethernet interface, connecting to PLC or PC end
③	X3	24V power input terminal	Module power input
④	X4	Input or output terminal	Digital signal points
⑤	X6	Address code switch	Switch for setting the last bit of the slave station IP address

4.2 SRX-MT Structure Diagram 32 Points

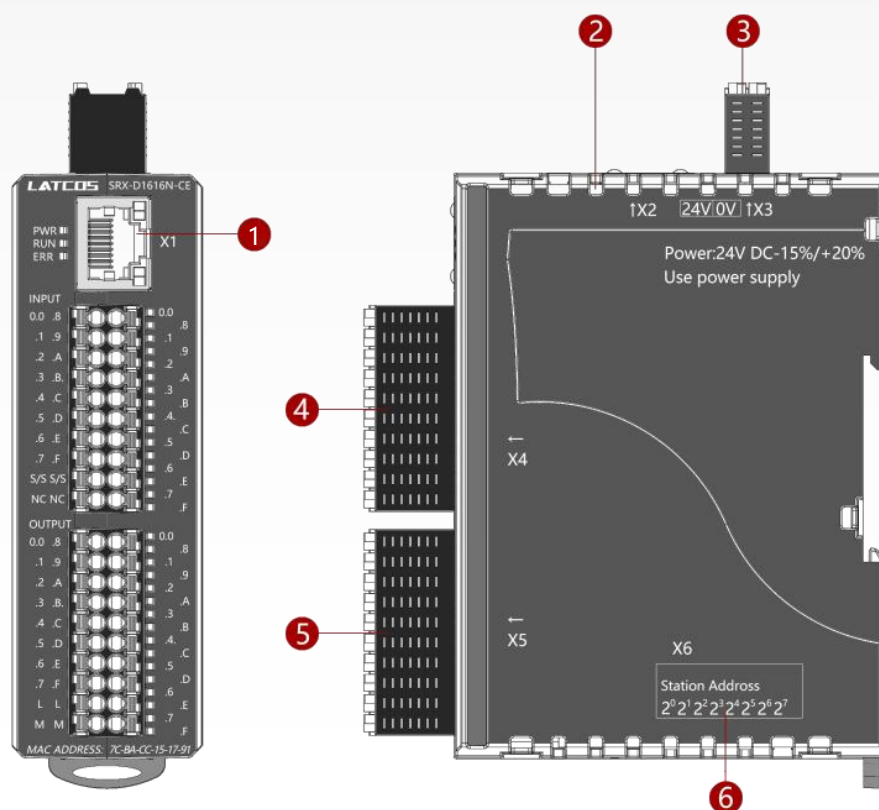



Figure 4 Module Wiring Diagram

order number	characteristic	The interface name	function definition
①	X1	RJ45 port	Ethernet interface, connecting to PLC or PC end
②	X2	RJ45 port	Ethernet interface, connecting to PLC or PC end
③	X3	24V power input terminal	Module power input
④	X4	Input or output terminal	Digital signal points
⑤	X5	Input or output terminal	Digital signal points
⑥	X6	Address code switch	Switch for setting the last digit of the slave station IP address

4.3 Communication interface

The module uses a physical interface with two RJ45 sockets for communication. The module itself has the function of a switch. They are respectively identified as X1P1 and X1P2. Each port has an independent MAC address that is adjacent to the identification mac on the module.

Table 6 ETHERNET IP Communication Interface

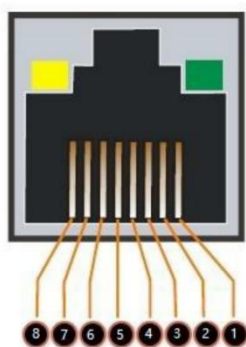

pin	signal	description
1	TD+	Data transmission positive terminal
2	TD-	Data transmission negative terminal
3	RD+	Data reception positive terminal
4	NC	Unused
5	NC	Unused
6	RX-	Data reception negative terminal
7	NC	Unused
8	NC	Unused

4.4 LED indication

The LED indicators of the module are divided into three parts: system status indicator, I/O status indicator, and RJ45 link indicator.

4.4.1 System status indicates the working condition of the system.

PWR(green)	ERR(red)	RUN(green)	Explanation
○	○	○	Power supply abnormality
●	●	○	Communication interface failure
●	○	●	The module has successfully entered the operating (operate) state and successfully established a cyclic data exchange with the main station.

Table 7 System Status Indicators ● Indicates that the green light remains constantly on

● Indicates that the red light remains constantly on ○ Indicates that it is not lit

4.4.2 I/O Status Indication

The digital input/output ports use green LEDs to indicate the status of the corresponding channels. When the light is on, it indicates that the logic state of the input/output port is "1", and when the light is off, it indicates that the logic state of the input/output port is "0".

4.4.3 RJ45 indicator light


Under normal circumstances, the RJ45 port indicator lights should be the green light constantly on and the yellow light flashing. If this is not the case, it indicates that a fault has occurred. If the green light is not on, it means there is a connection fault with the RJ45 port that is connected to a Hub or switch; if the yellow light is not on, it might be a fault with the module itself.

As shown in Table 7: RJ45 Indicator Light Explanation

LINK1/LINK2	ACT1/ACT2	Explanation
○	Not related	The RJ45 port is not connected to a network cable or the connection is poor.
●	Not related	The RJ45 port has correctly identified the Ethernet network.
Not related	○	There is no data exchange at the RJ45 port.
Not related	●	There is data exchange at the RJ45 port.

Table 8 RJ45 Indicator Light Explanation

4.5 Communication power supply

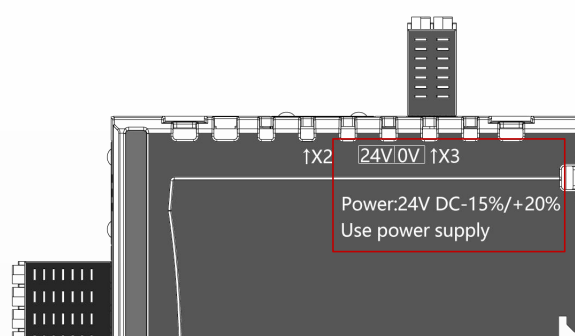


24V	24V, positive terminal of the DC power supply
0V	0V, negative terminal of the DC power supply

Table 9 Power Connection Terminals

The control voltage uses 24V DC (-15% / +20%), with a maximum current consumption of 0.5A, and has polarity reverse protection; the electrical isolation withstand voltage between it and other I/O components is 500V DC.

4.6 Dial switch

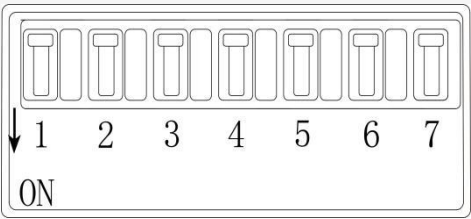

Number	Explanation	ON	OFF
1	Address Digits	1	0
2		2	0
3		4	0
4		8	0
5		16	0
6		32	0
7		64	0

Table 10 Dial Switch Functions


Note:


- a. The module's jumpers are preset to the settings of software LAEconfig at the factory, meaning all the jumpers are in the OFF state.
- b. When the cumulative value of the jumpers is greater than 0, this cumulative value represents the last digit of the module's IP address.

(For example: Serial numbers 1, 2, and 7 are in the ON state, while the rest are in the OFF state. If the cumulative value is 67 at this time, then the module's IP address is: ***.***.***.67)

4.7 Module terminal wiring diagram

4.7.1 Wiring diagram of the digital quantity module

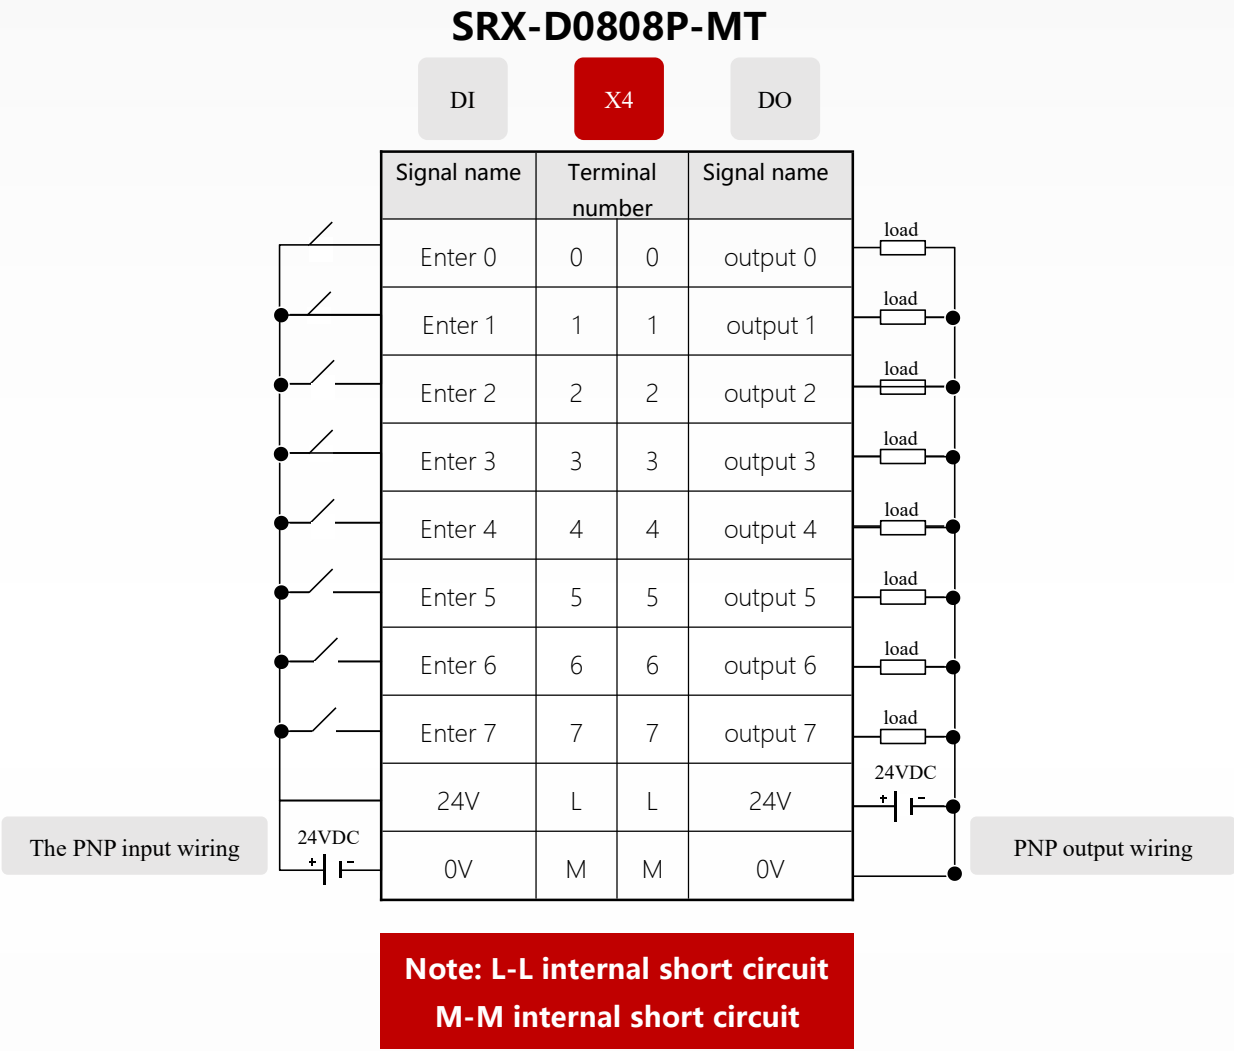

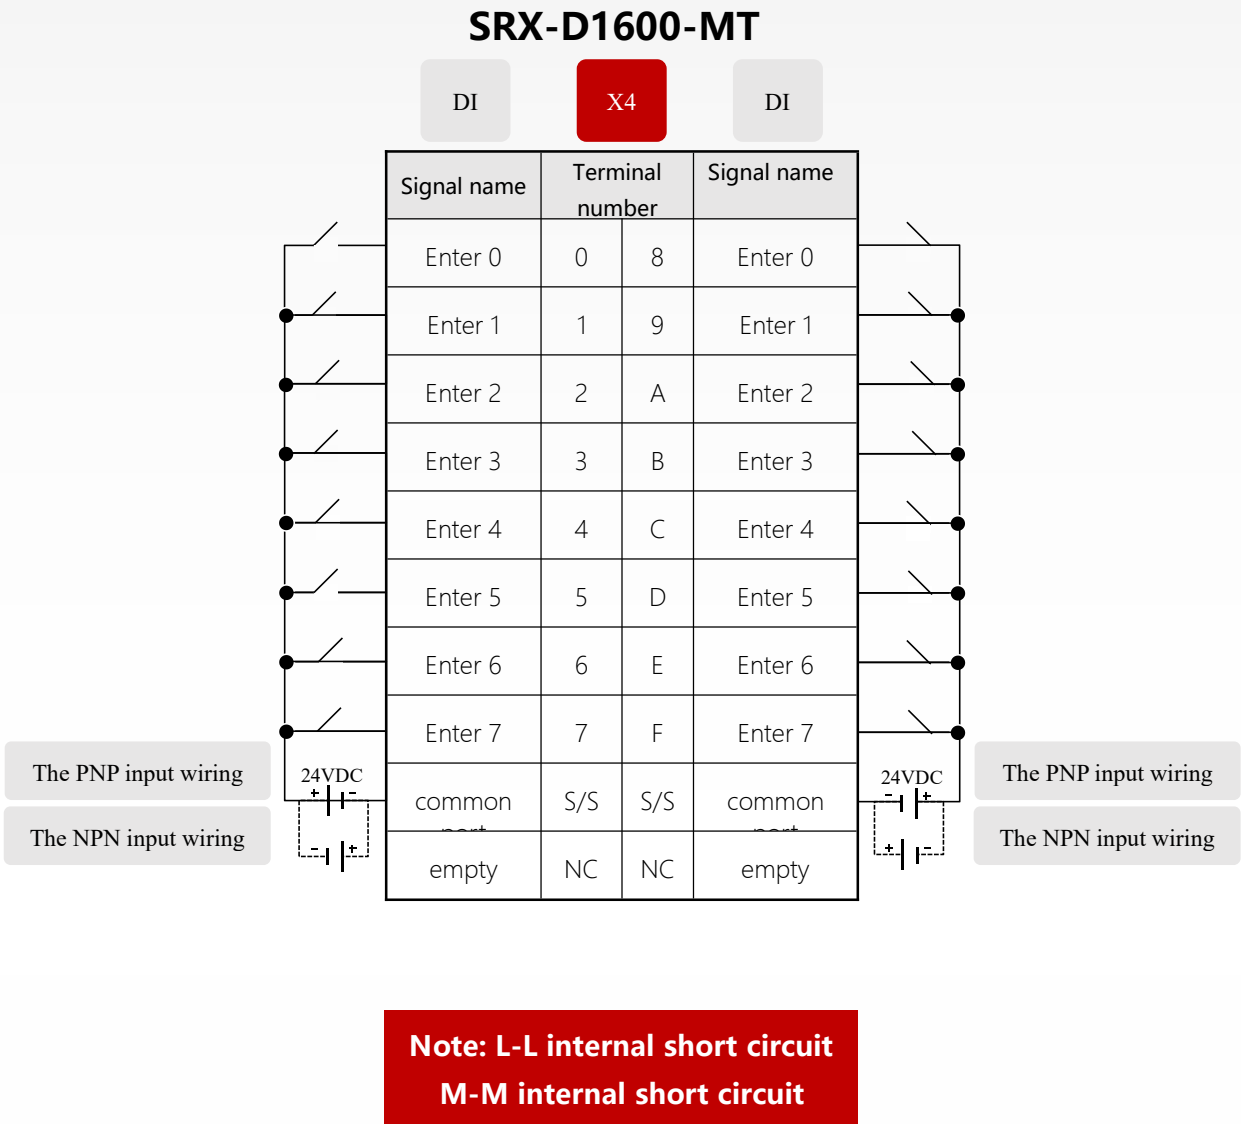


SRX-D0016P-MT

DO


X4

DO

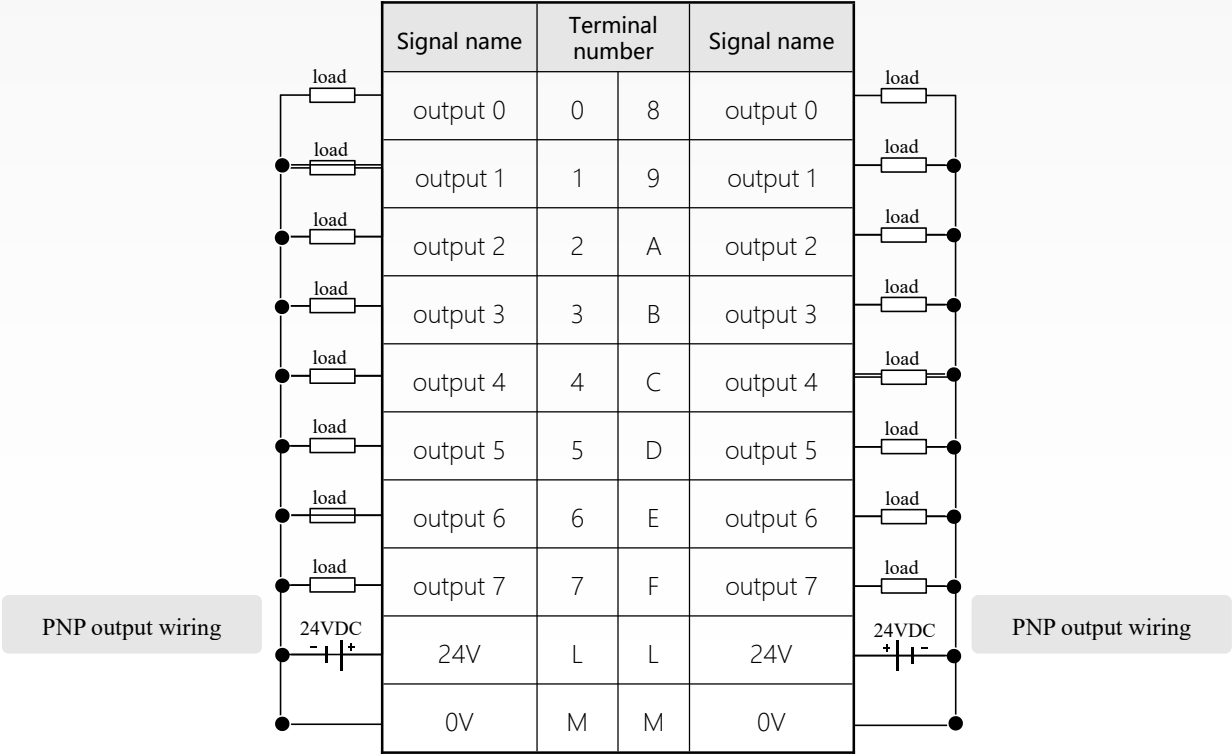


Note: L-L internal short circuit
M-M internal short circuit

SRX-D0808N-MT

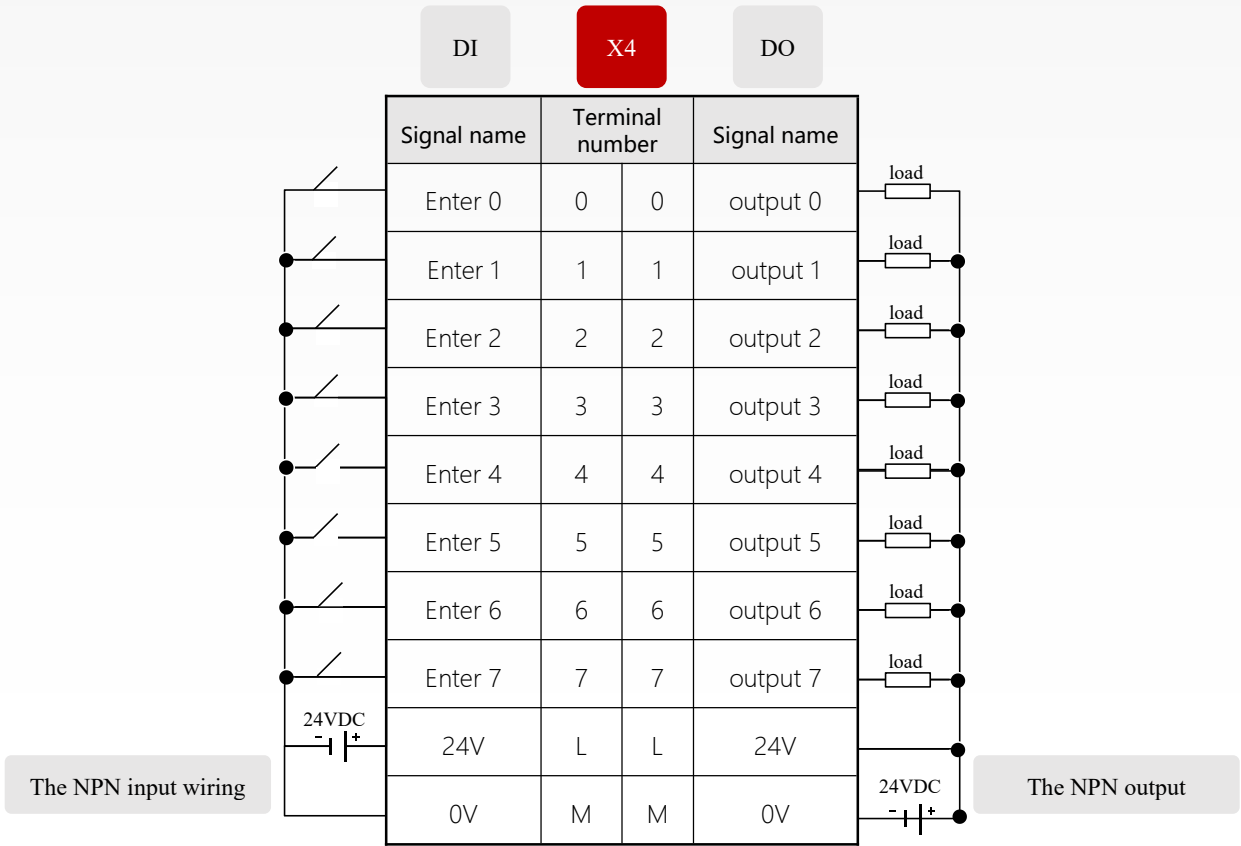



Note: L-L internal short circuit
M-M internal short circuit

SRX-D0016N-MT

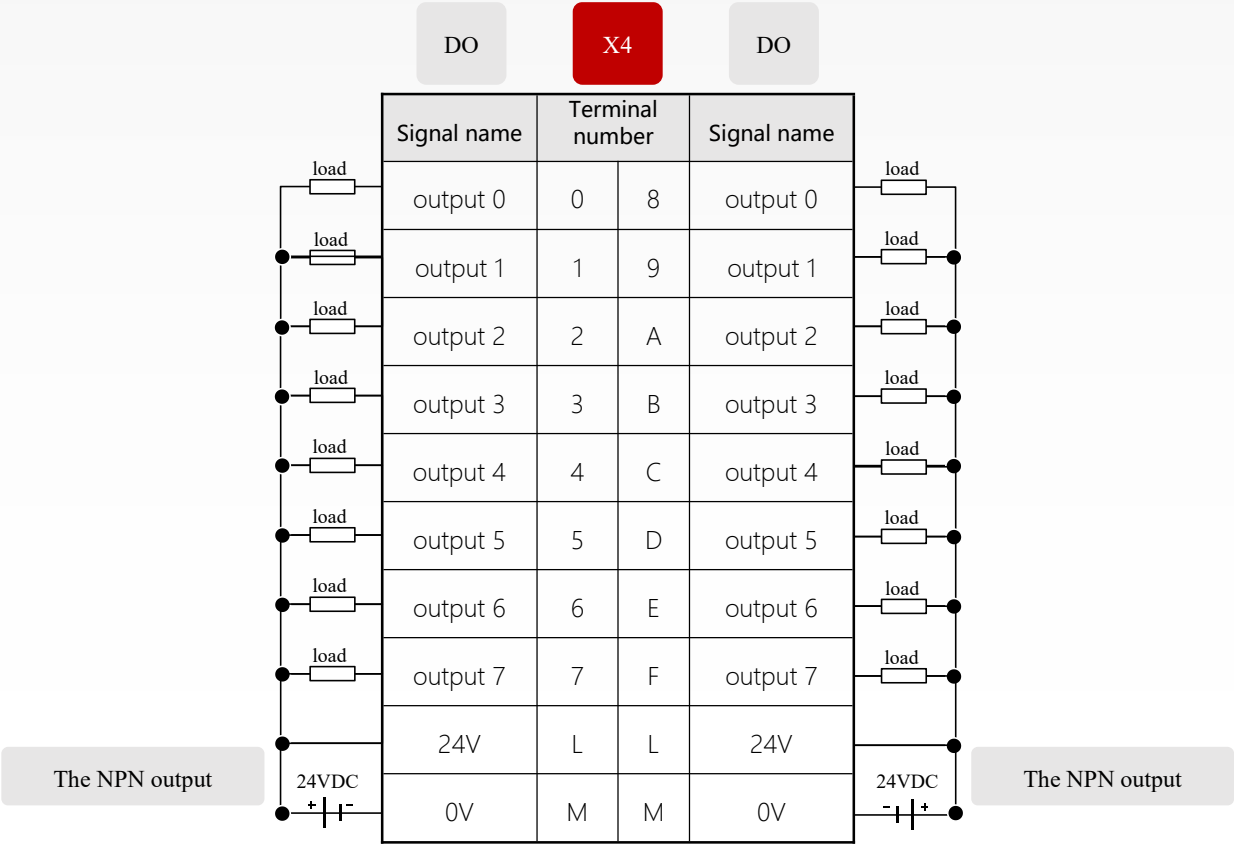

Note: L-L internal short circuit
M-M internal short circuit

SRX-D3200-MT

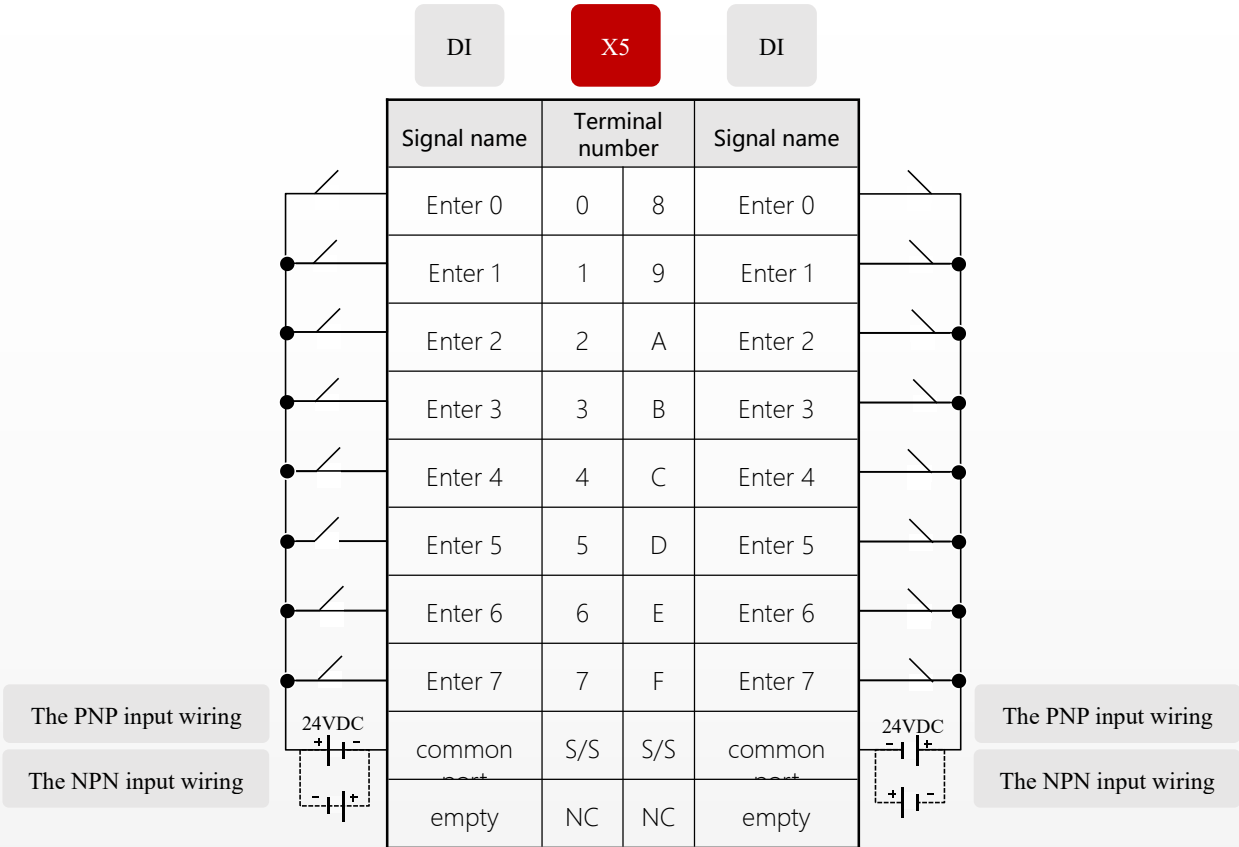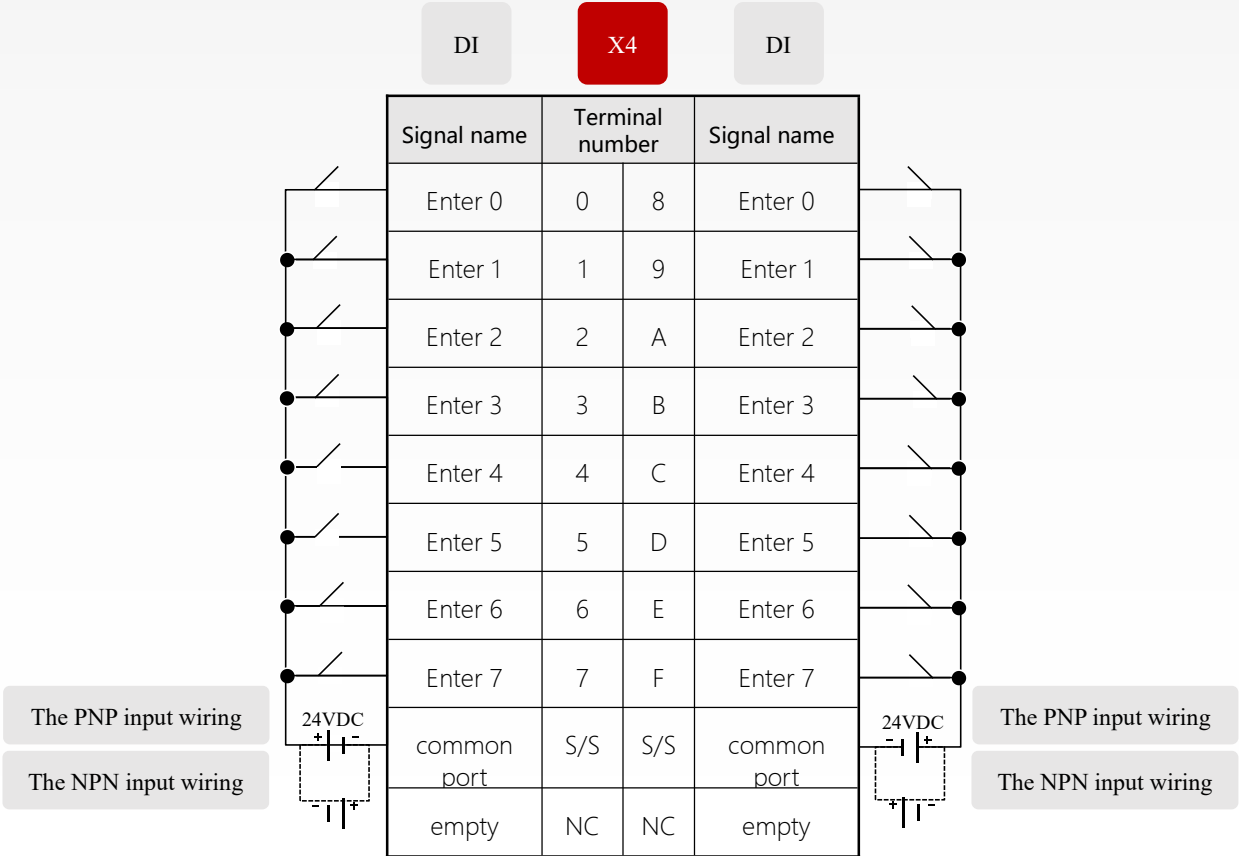


SRX-D0032P-MT

DO

X4


DO

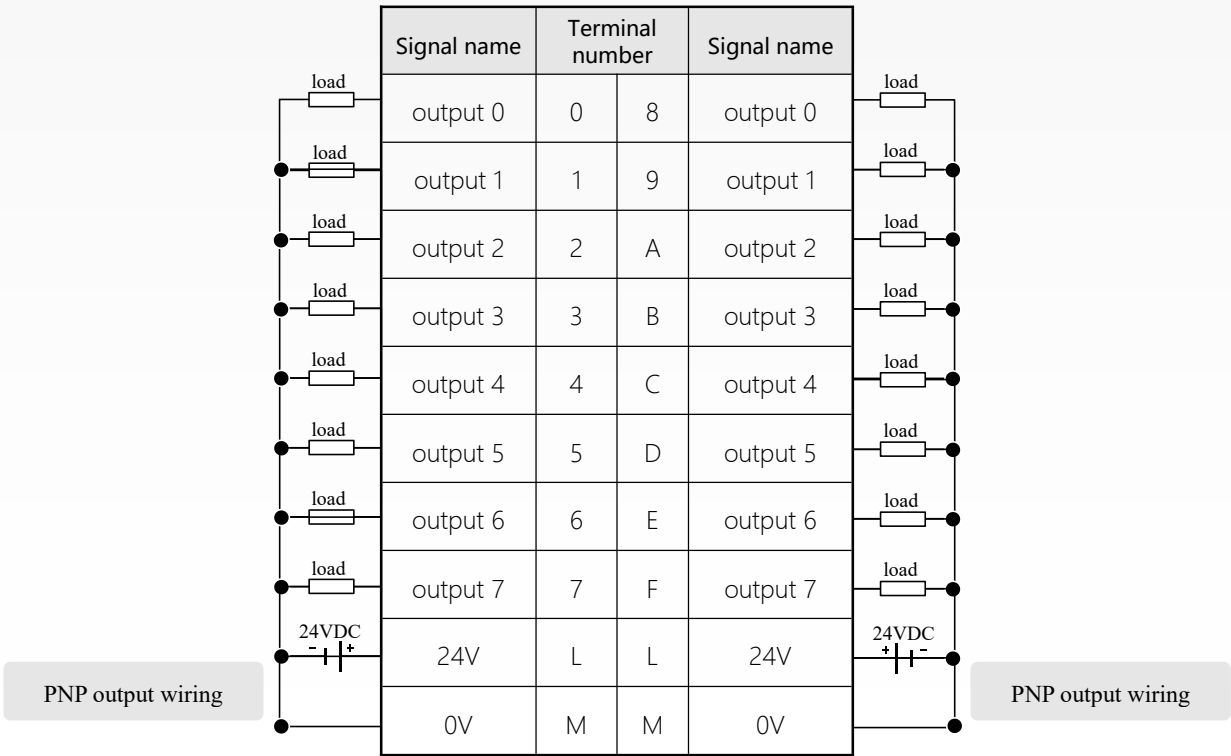

DO

X5

DO

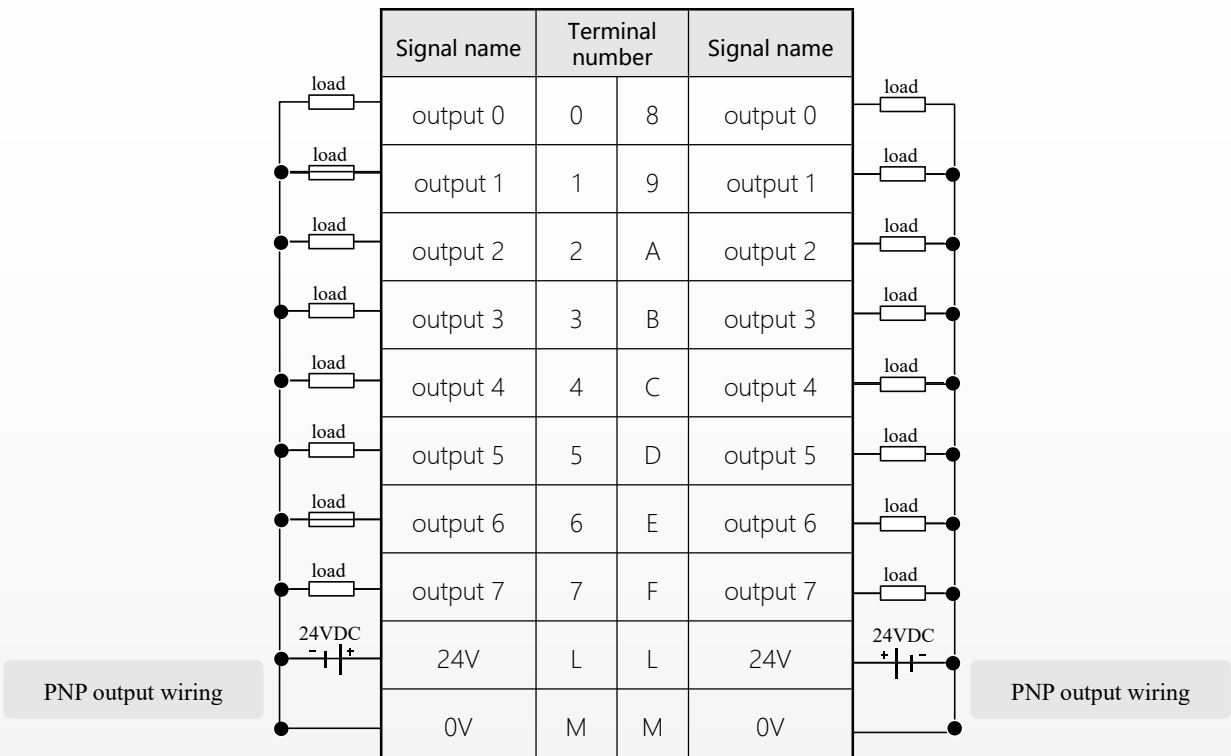


Note: L-L internal short circuit
M-M internal short circuit

SRX-D0032N-MT

DO

X4


DO

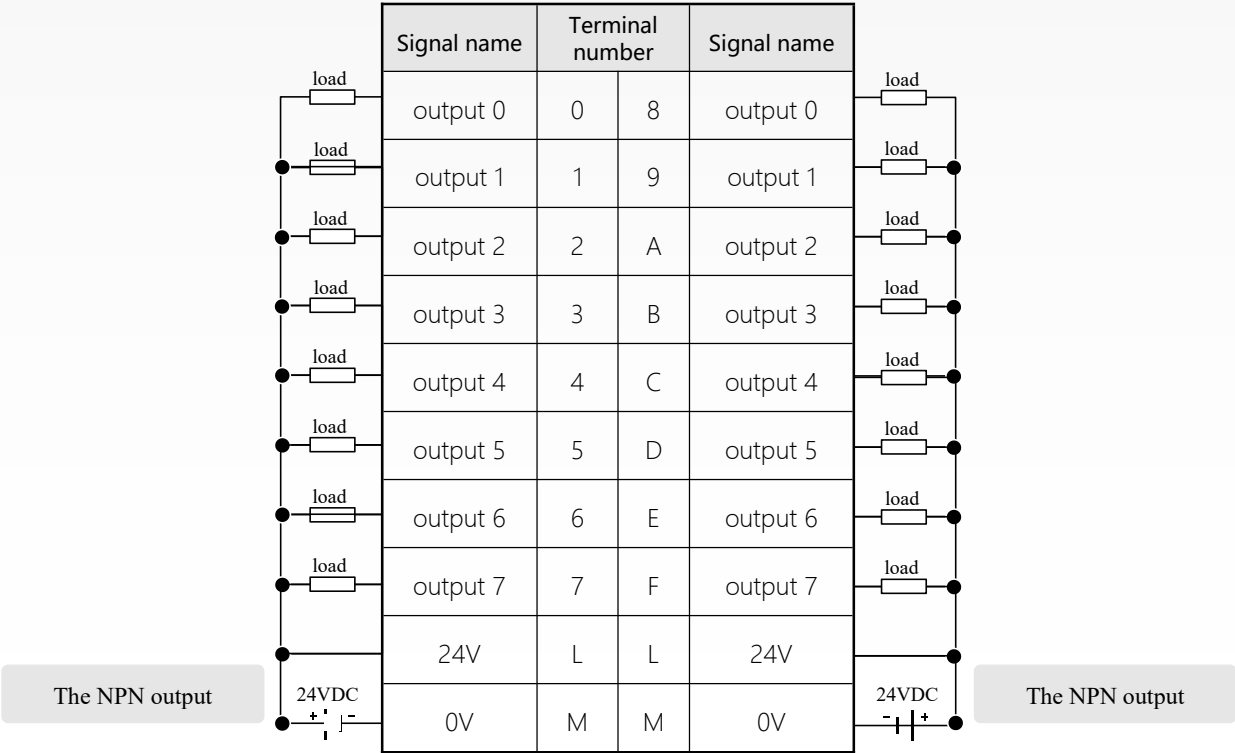

DO



X5

DO

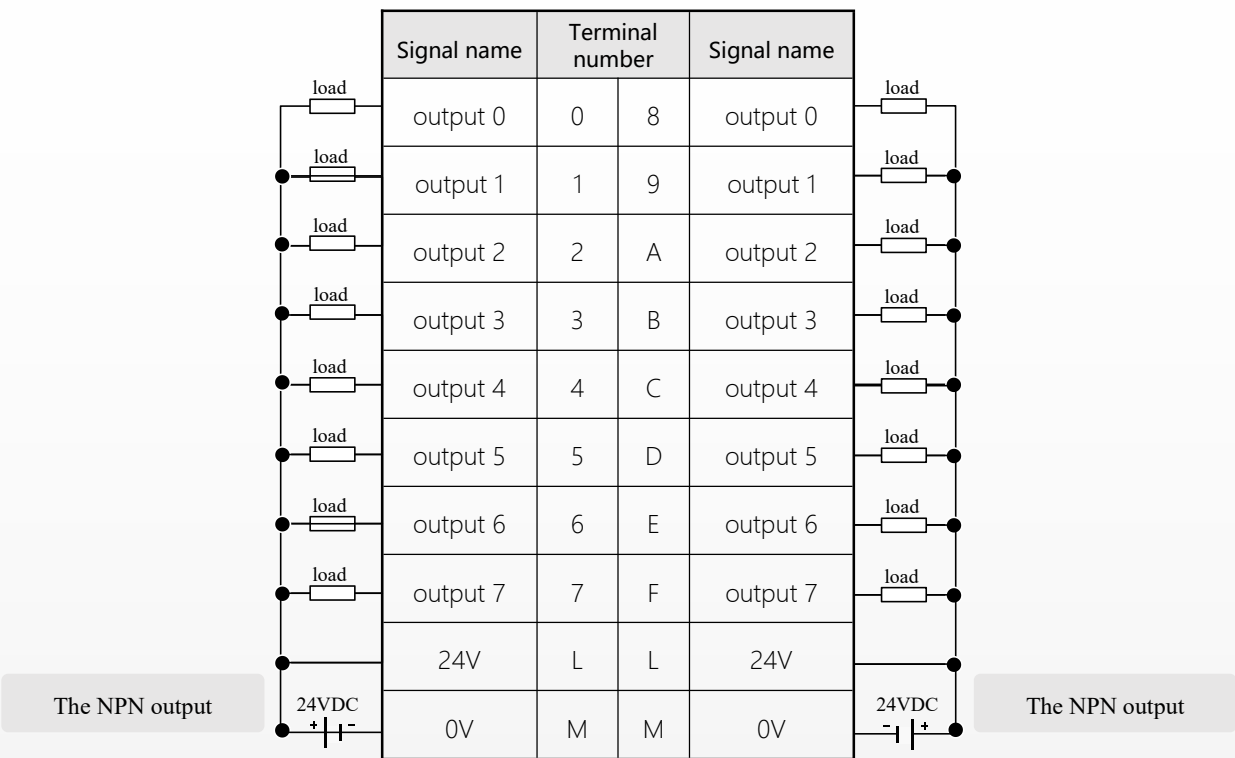



Note: L-L internal short circuit
M-M internal short circuit

SRX-D1616P-MT

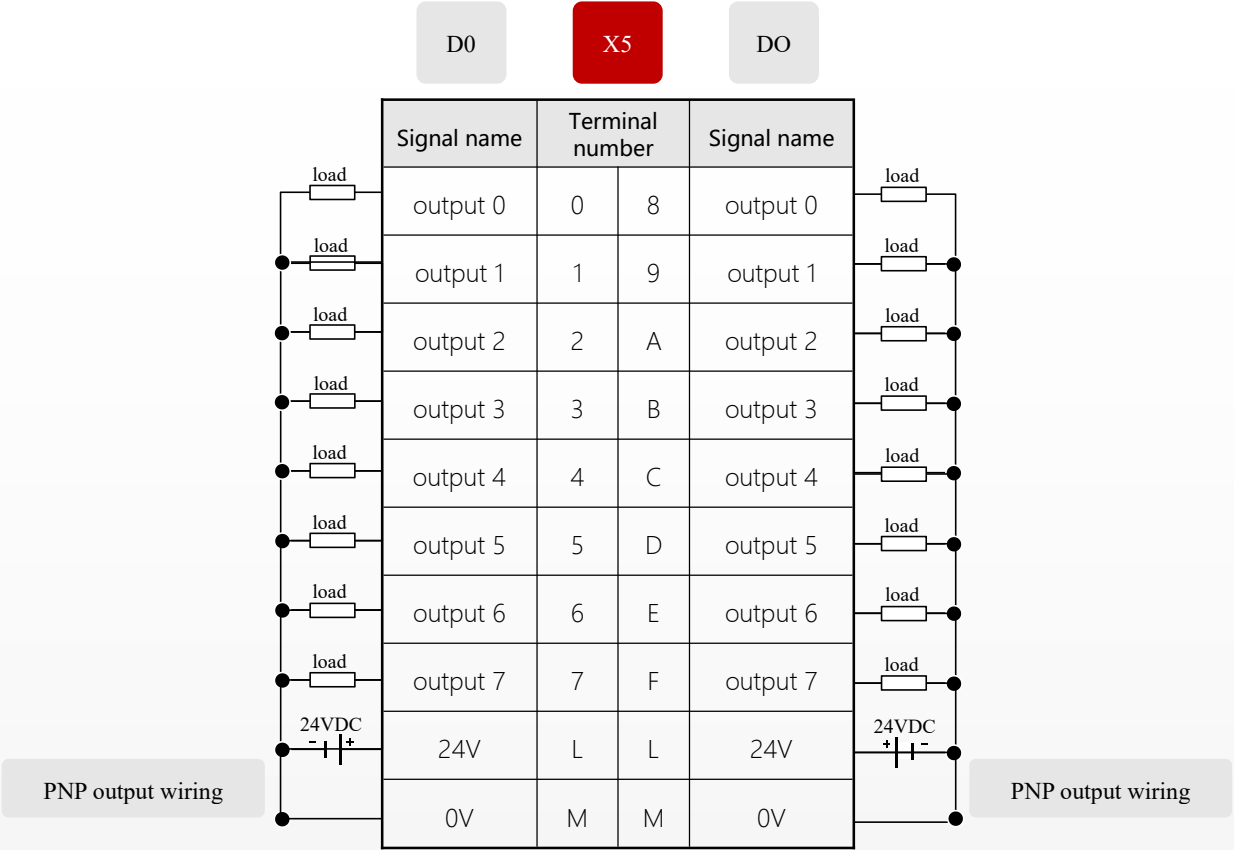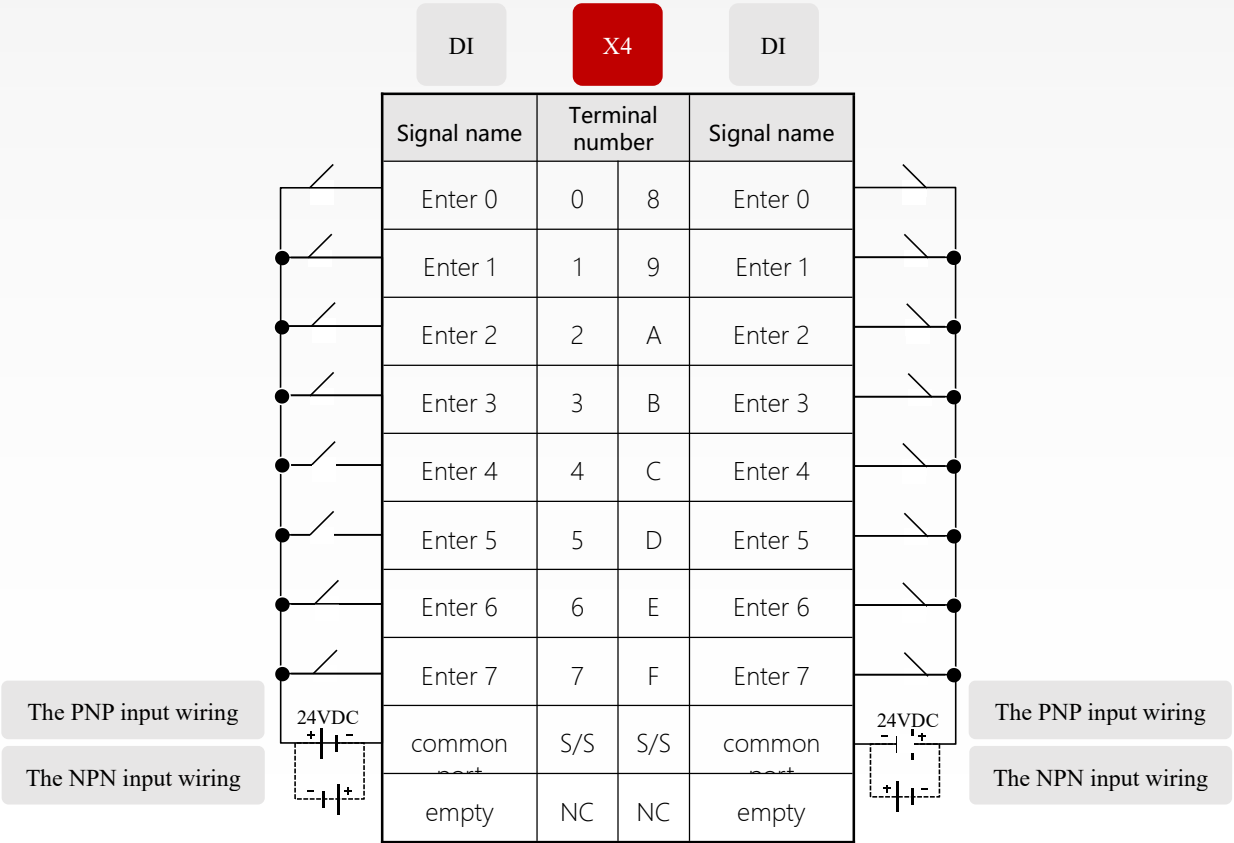

Note: L-L internal short circuit
M-M internal short circuit


SRX-D1616N-MT

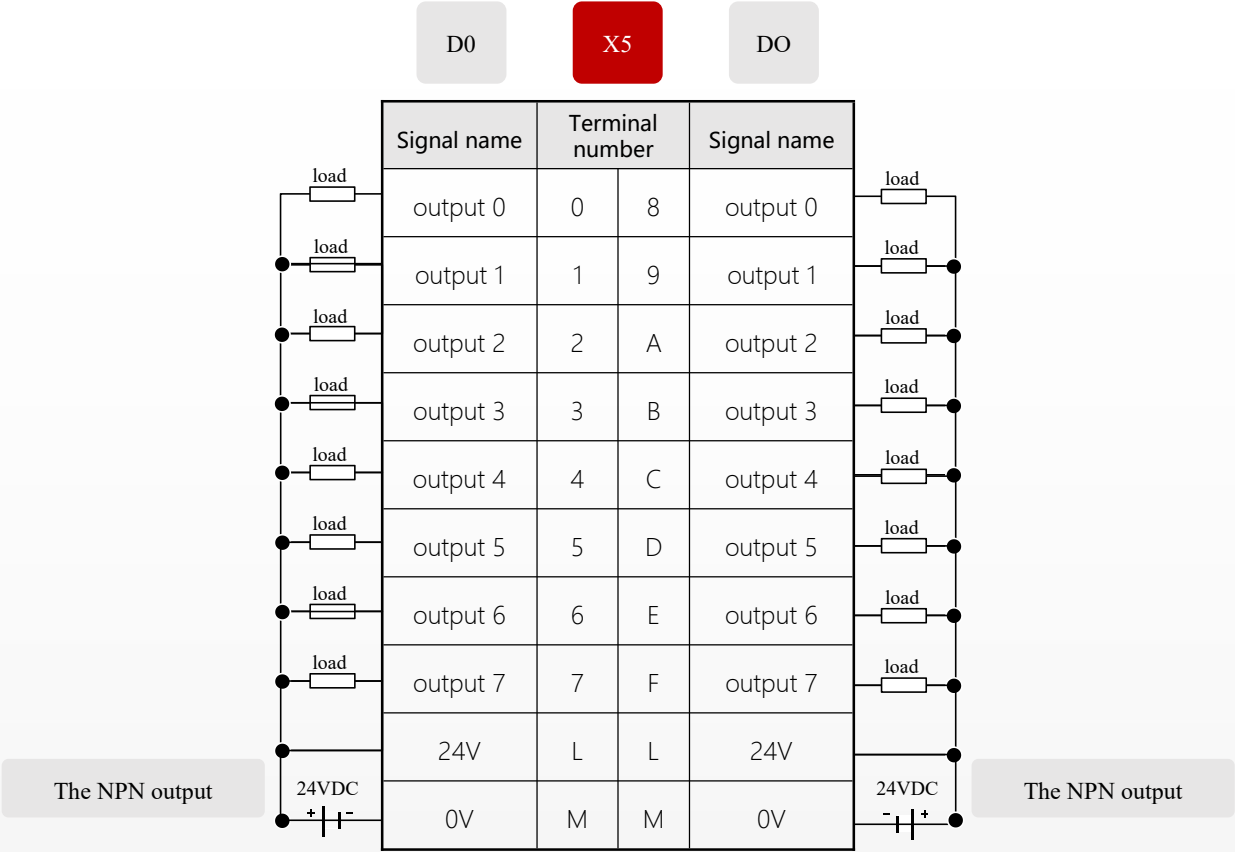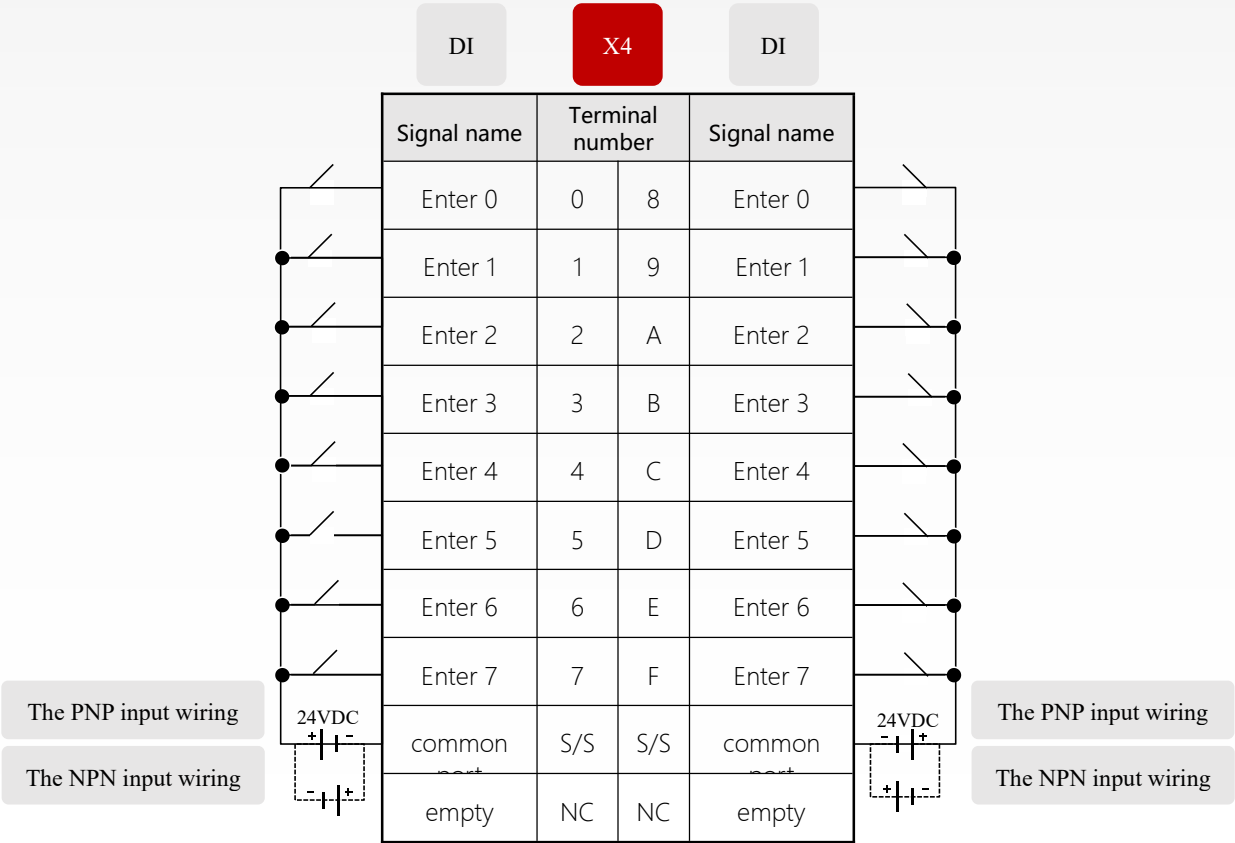


Note: L-L internal short circuit
M-M internal short circuit

4.7.2 Wiring diagram of the analog quantity module

SRX-A0600-MT

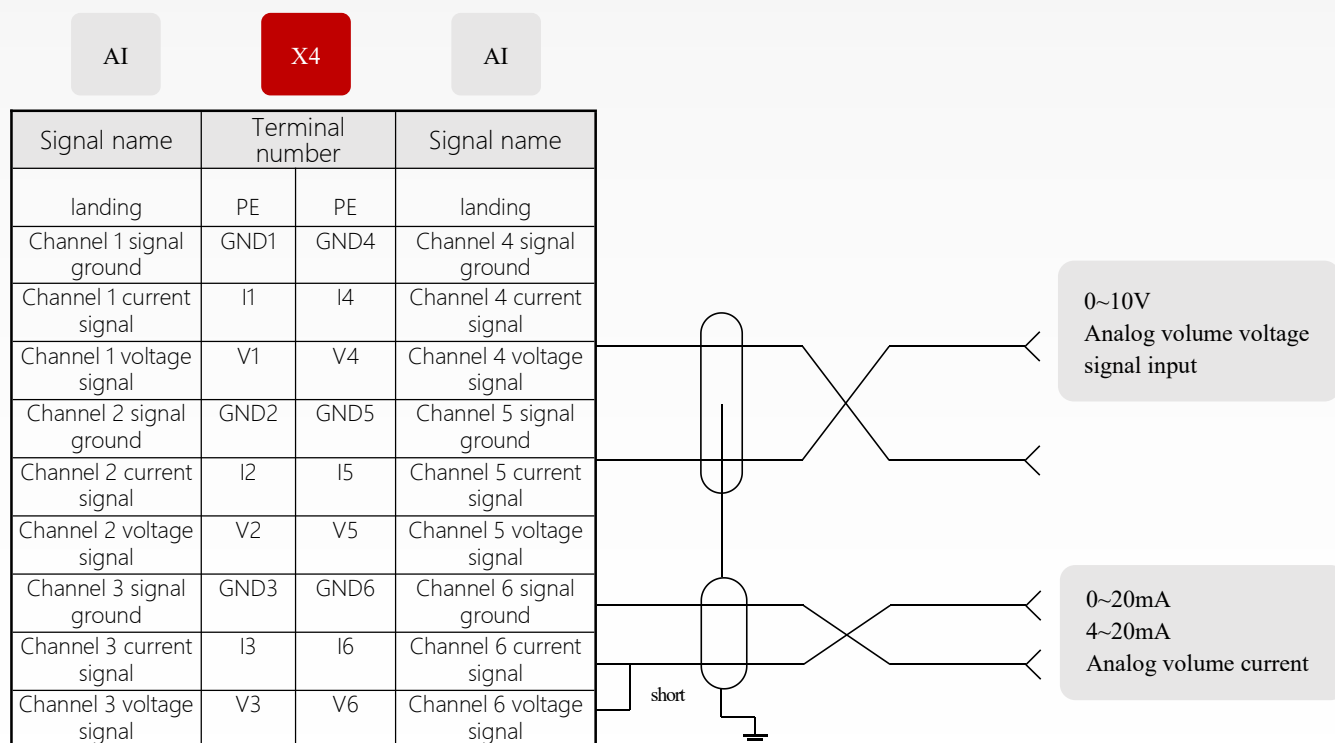

SRX-A0004-MT

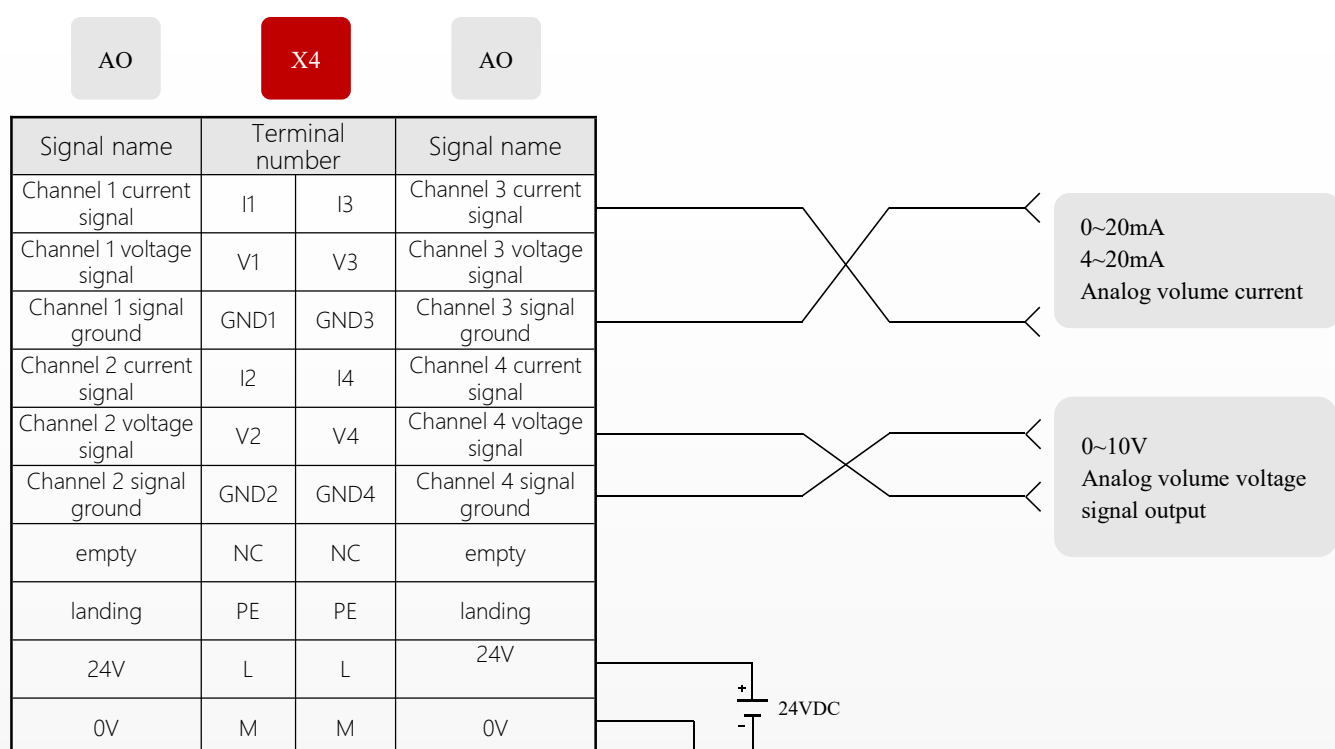


SRX-A0604-MT

AI

X4

AI

Signal name	Terminal number		Signal name
landing	PE	PE	landing
Channel 1 signal ground	GND1	GND4	Channel 4 signal ground
Channel 1 current signal	I1	I4	Channel 4 current signal
Channel 1 voltage signal	V1	V4	Channel 4 voltage signal
Channel 2 signal ground	GND2	GND5	Channel 5 signal ground
Channel 2 current signal	I2	I5	Channel 5 current signal
Channel 2 voltage signal	V2	V5	Channel 5 voltage signal
Channel 3 signal ground	GND3	GND6	Channel 6 signal ground
Channel 3 current signal	I3	I6	Channel 6 current signal
Channel 3 voltage signal	V3	V6	Channel 6 voltage signal

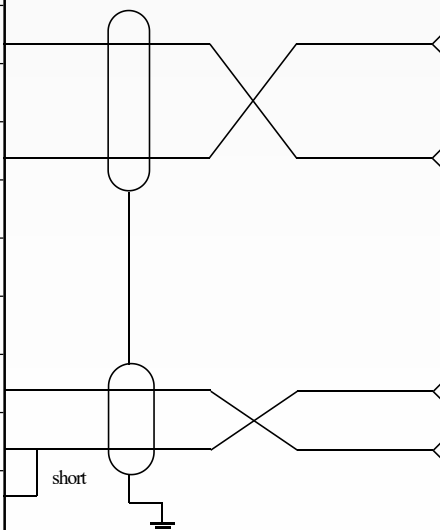

0~10V
Analog volume voltage
signal input


0~20mA
4~20mA
Analog volume current

AO

X5

AO

Signal name	Terminal number		Signal name
Channel 1 current signal	I1	I3	Channel 3 current signal
Channel 1 voltage signal	V1	V3	Channel 3 voltage signal
Channel 1 signal ground	GND1	GND3	Channel 3 signal ground
Channel 2 current signal	I2	I4	Channel 4 current signal
Channel 2 voltage signal	V2	V4	Channel 4 voltage signal
Channel 2 signal ground	GND2	GND4	Channel 4 signal ground
empty	NC	NC	empty
landing	PE	PE	landing
24V	L	L	24V
0V	M	M	0V

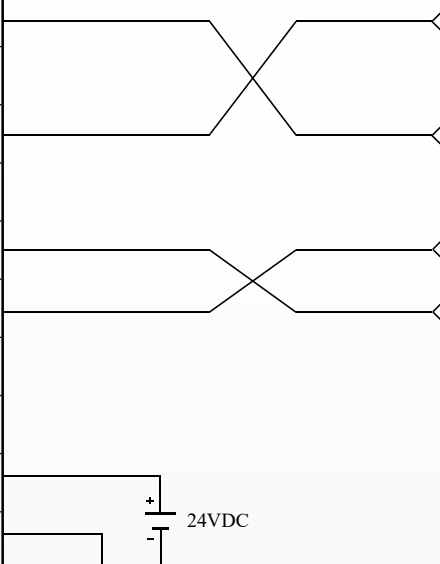

0~20mA
4~20mA
Analog volume current

0~10V
Analog volume voltage
signal output

24VDC


SRX-A1200-MT

AI

X4

AI

Signal name	Terminal number		Signal name
landing	PE	PE	landing
Channel 1 signal ground	GND1	GND4	Channel 4 signal ground
Channel 1 current signal	I1	I4	Channel 4 current signal
Channel 1 voltage signal	V1	V4	Channel 4 voltage signal
Channel 2 signal ground	GND2	GND5	Channel 5 signal ground
Channel 2 current signal	I2	I5	Channel 5 current signal
Channel 2 voltage signal	V2	V5	Channel 5 voltage signal
Channel 3 signal ground	GND3	GND6	Channel 6 signal ground
Channel 3 current signal	I3	I6	Channel 6 current signal
Channel 3 voltage signal	V3	V6	Channel 6 voltage signal

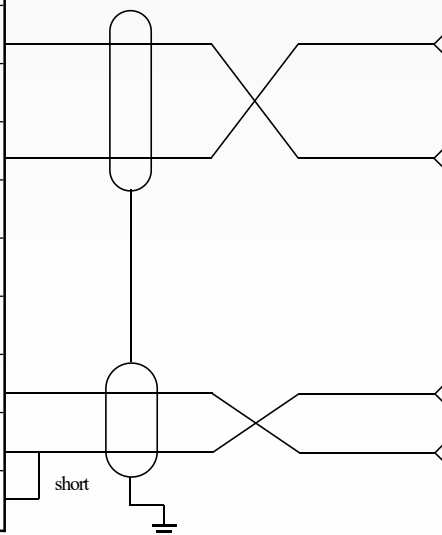

0~10V
Analog volume voltage
signal input


0~20mA
4~20mA
Analog volume current

AI

X5

AI

Signal name	Terminal number		Signal name
landing	PE	PE	landing
Channel 1 signal ground	GND1	GND4	Channel 4 signal ground
Channel 1 current signal	I1	I4	Channel 4 current signal
Channel 1 voltage signal	V1	V4	Channel 4 voltage signal
Channel 2 signal ground	GND2	GND5	Channel 5 signal ground
Channel 2 current signal	I2	I5	Channel 5 current signal
Channel 2 voltage signal	V2	V5	Channel 5 voltage signal
Channel 3 signal ground	GND3	GND6	Channel 6 signal ground
Channel 3 current signal	I3	I6	Channel 6 current signal
Channel 3 voltage signal	V3	V6	Channel 6 voltage signal

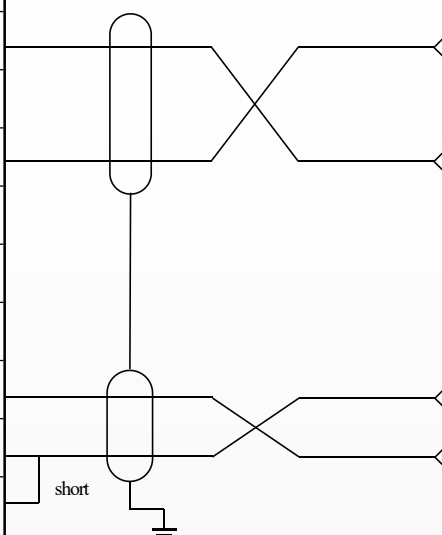

0~10V
Analog volume voltage
signal input


0~20mA
4~20mA
Analog volume current

SRX-A0008-MT

AO

X4


AO

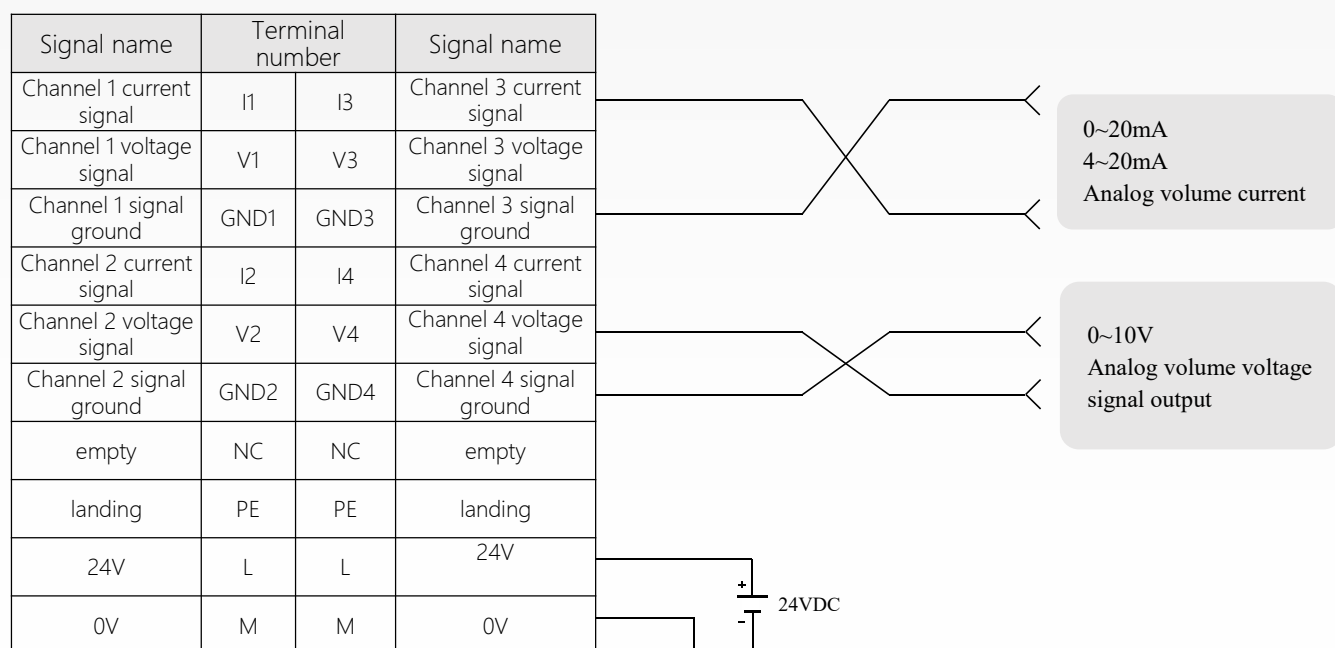

AO


X5

AO

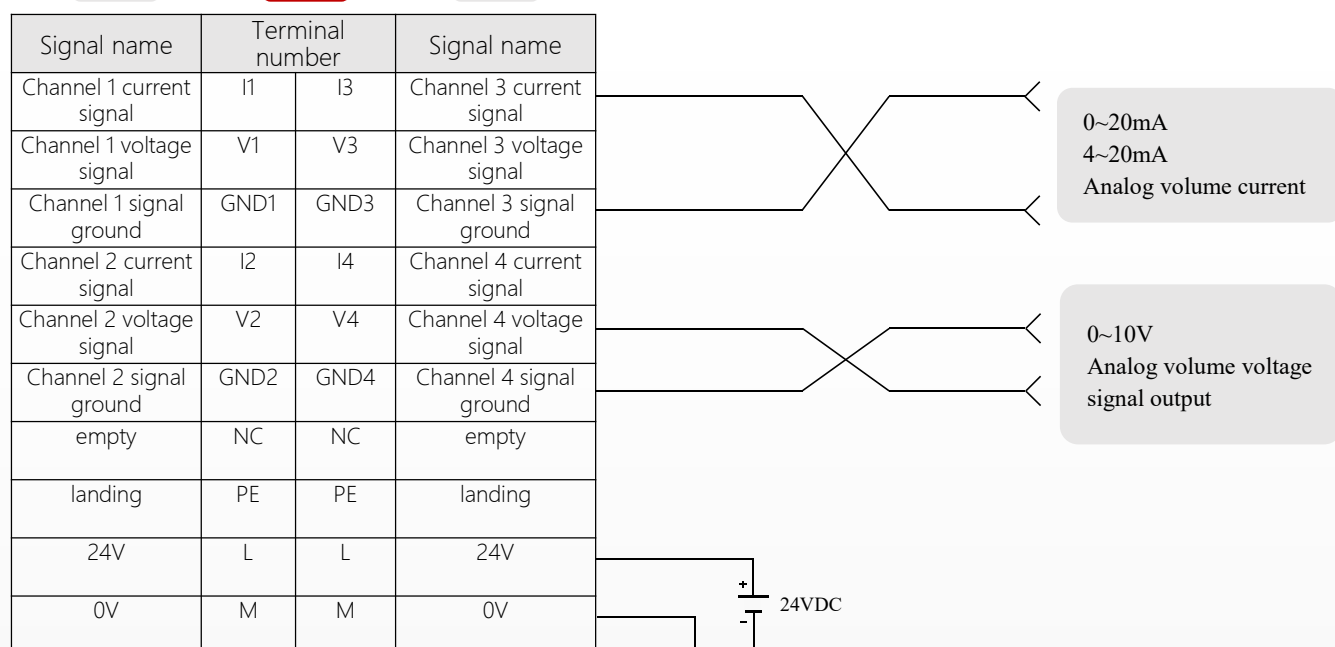


4.7.3 Wiring diagram of the temperature module

SRX-8RTD-MT

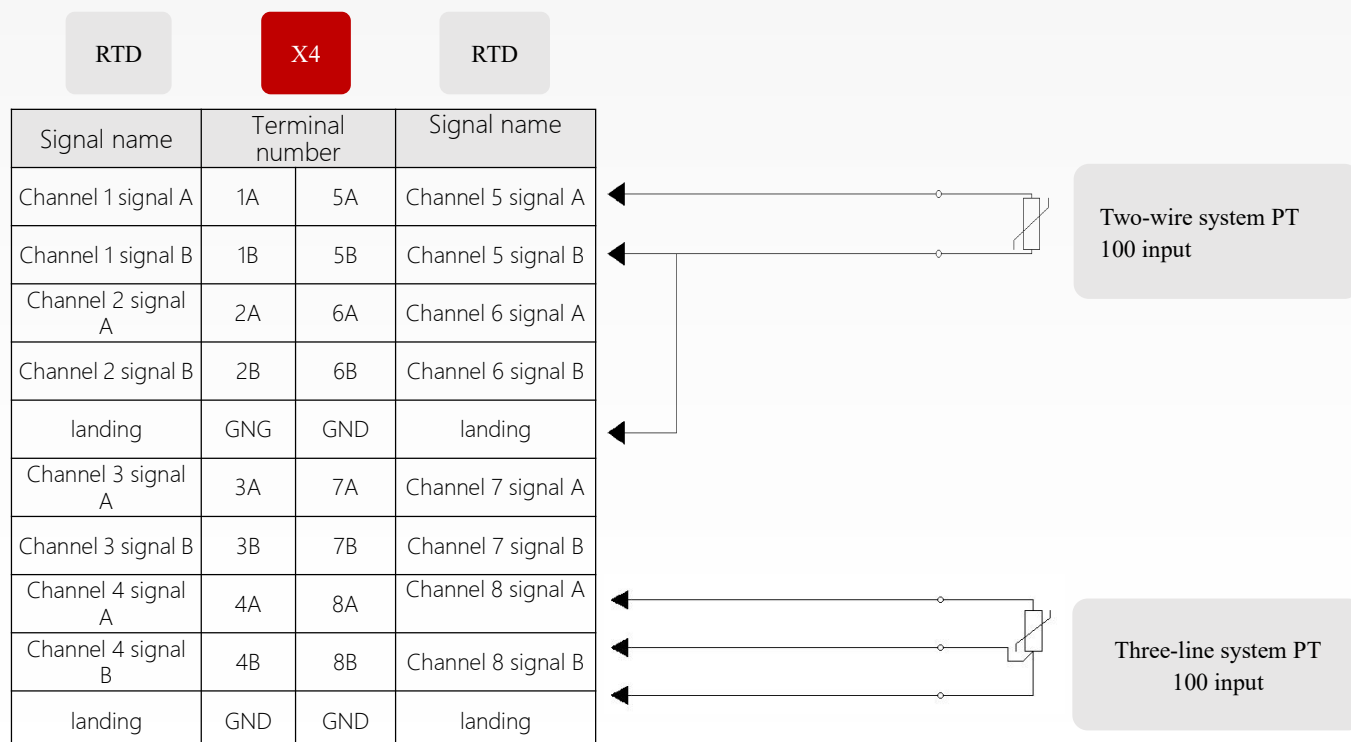

SRX-8TC-MT

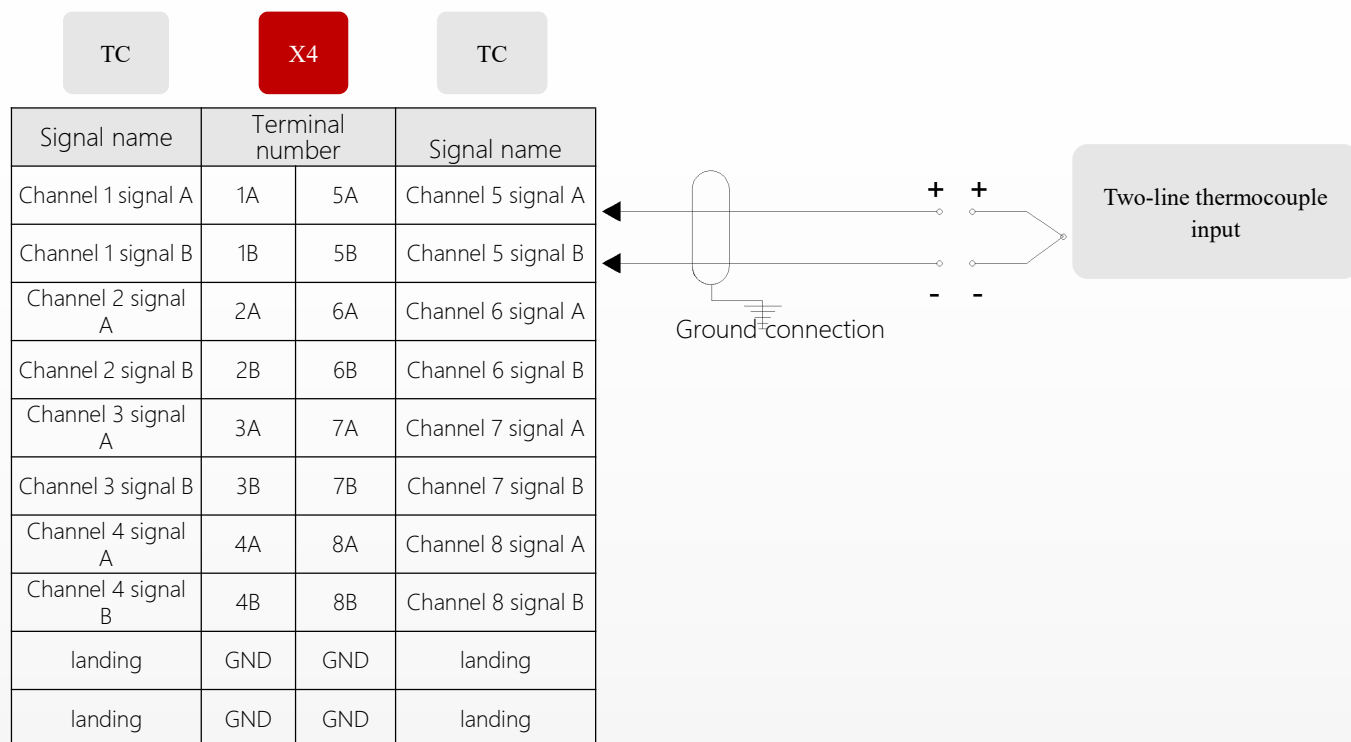


SRX-16RTD-MT

RTD1

X4

RTD1

Signal name	Terminal number		Signal name
Channel 1 signal A	1A	5A	Channel 5 signal A
Channel 1 signal B	1B	5B	Channel 5 signal B
Channel 2 signal A	2A	6A	Channel 6 signal A
Channel 2 signal B	2B	6B	Channel 6 signal B
landing	GNG	GND	landing
Channel 3 signal A	3A	7A	Channel 7 signal A
Channel 3 signal B	3B	7B	Channel 7 signal B
Channel 4 signal A	4A	8A	Channel 8 signal A
Channel 4 signal B	4B	8B	Channel 8 signal B
landing	GND	GND	landing

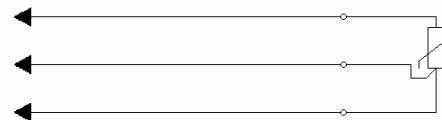
Two-wire system PT
100 inputThree-line system PT
100 input

RTD2

X5

RTD2

Signal name	Terminal number		Signal name
Channel 1 signal A	1A	5A	Channel 5 signal A
Channel 1 signal B	1B	5B	Channel 5 signal B
Channel 2 signal A	2A	6A	Channel 6 signal A
Channel 2 signal B	2B	6B	Channel 6 signal B
landing	GNG	GND	landing
Channel 3 signal A	3A	7A	Channel 7 signal A
Channel 3 signal B	3B	7B	Channel 7 signal B
Channel 4 signal A	4A	8A	Channel 8 signal A
Channel 4 signal B	4B	8B	Channel 8 signal B
landing	GND	GND	landing

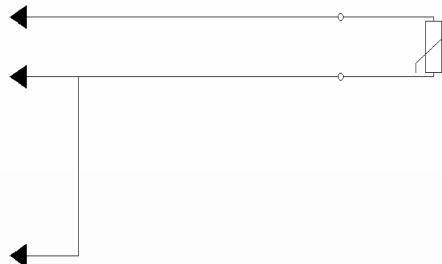Two-wire system PT
100 inputThree-line system PT
100 input


SRX-16TC-MT

TC1

X4

TC1

Signal name	Terminal number		
Channel 1 signal A	1A	5A	Channel 5 signal A
Channel 1 signal B	1B	5B	Channel 5 signal B
Channel 2 signal A	2A	6A	Channel 6 signal A
Channel 2 signal B	2B	6B	Channel 6 signal B
Channel 3 signal A	3A	7A	Channel 7 signal A
Channel 3 signal B	3B	7B	Channel 7 signal B
Channel 4 signal A	4A	8A	Channel 8 signal A
Channel 4 signal B	4B	8B	Channel 8 signal B
landing	GND	GND	landing
landing	GND	GND	landing

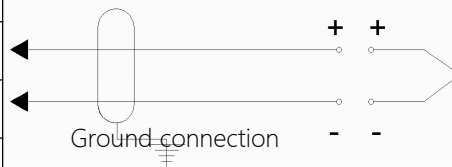


Two-line thermocouple input

TC2

X4

TC2

Signal name	Terminal number		
Channel 1 signal A	1A	5A	Channel 5 signal A
Channel 1 signal B	1B	5B	Channel 5 signal B
Channel 2 signal A	2A	6A	Channel 6 signal A
Channel 2 signal B	2B	6B	Channel 6 signal B
Channel 3 signal A	3A	7A	Channel 7 signal A
Channel 3 signal B	3B	7B	Channel 7 signal B
Channel 4 signal A	4A	8A	Channel 8 signal A
Channel 4 signal B	4B	8B	Channel 8 signal B
landing	GND	GND	landing
landing	GND	GND	landing

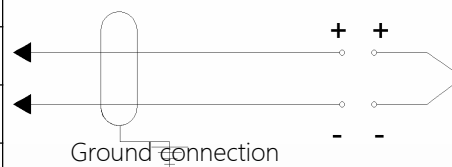

Two-line thermocouple input


★ For the wiring diagram of other hybrid modules, please download the CAD

diagram www.latcos.cn from the official website

4.7.4 4-20mA definition and line graph

Current measurement range value			
System		Current measurement range	
Decimal	Hexadecimal	4mA~20mA	
32767	7FFF		Overflow
32767	7FFF	20mA	Rated range
0	0	4mA	Downward range
-1	FFFF		Underflow
-1024	FFFF_FC00	3.5mA	Overflow
-27648	FFFF_8001		Rated range

4~20mA current line diagram

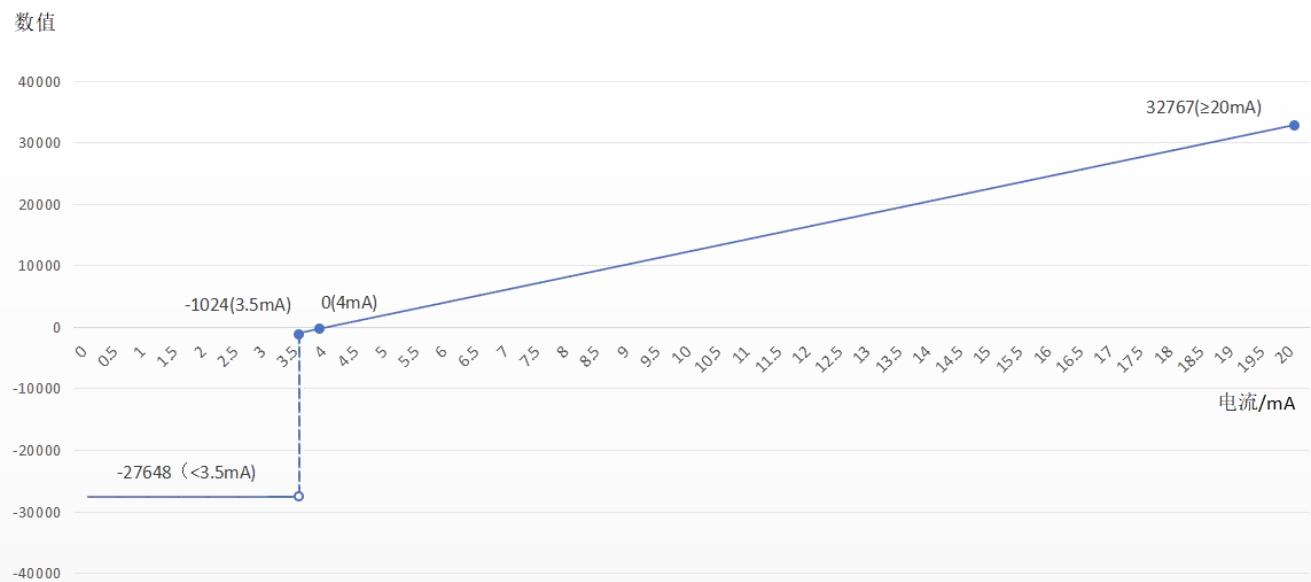



5.Modbus-TCP Protocol

5.1 Modbus-TCP Industrial Ethernet Protocol

5.1.1 What is Modbus-TCP ?

Definition:

MODBUS/TCP is a derivative product of the simple, neutral vendor's MODBUS series of communication protocols used for managing and controlling automated equipment. Obviously, it covers the application of MODBUS messages in environments using TCP/IP protocols such as "Intranet" and "Internet". The most common use of the protocol is for services such as PLCs, I/O modules, and gateways connecting to other simple domain buses or I/O modules.

The Modbus TCP protocol adds the MBAP message header before the RTU protocol. Since TCP is a reliable connection-based service, the CRC check code in the RTU protocol is no longer necessary, so there is no CRC check code in the Modbus TCP protocol. (The main difference in usage). MBAP message header: Transaction processing identifier (2 bytes) Protocol identifier (2 bytes) Length (2 bytes) Unit identifier (1 byte)

5.2 Network topology

Modbus-TCP has three typical network topologies, as shown in Figures 5-1, 5-2, and 5-3.

5.2.1 Star network

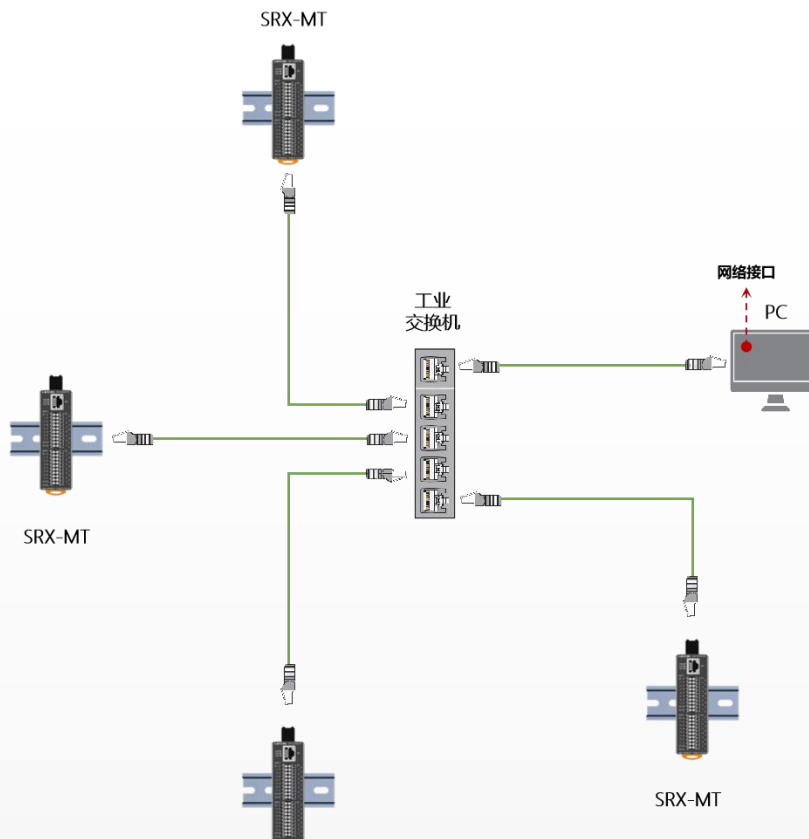


Figure 5-1 Modbus-TCP Star Network Topology Structure

5.2.2 Daisy-chain network

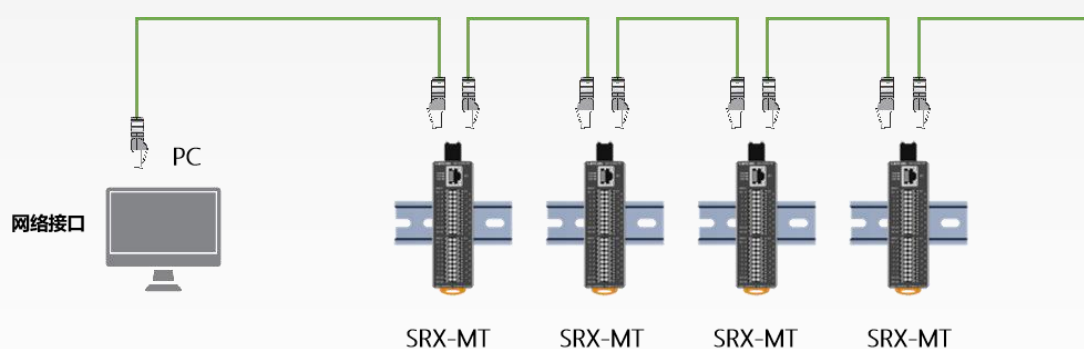


Figure 5-2 Modbus-TCP Daisy Chain Network Topology Structure

5.2.3 Tree-shaped network

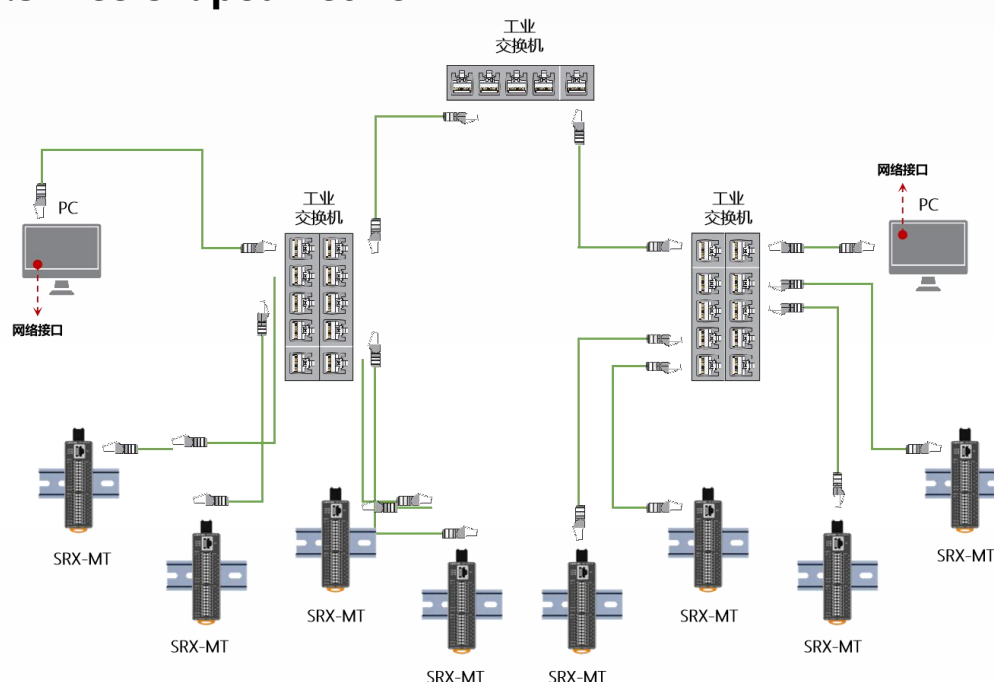


Figure 5-3 Modbus-TCP Tree Network Topology Structure

5.3 SRX-MT Address Mapping

The SRX-MTDI/DQ/AI/AQ data is mapped to the main station's memory space through the configuration profile.

- 16 digital input signals are mapped to 2-byte In addresses;
- 6 analog input signals are mapped to 12-byte In addresses;
- 16 digital output signals are mapped to 2-byte Out addresses;

5.4 Module Parameters

Each module has specific parameters, which need to be flexibly configured in the hardware configuration based on the actual site conditions. Parameter configuration and download are carried out using the LAEconfig software. Specific operations can be found in the LAEconfig manual.

SRX-D0808X-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Input the filter time (Filter)							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Input filter time	Filter	ms	decimal system	0-255 (Default: 5)				
output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode
(DO Error_Mode bits 0-7)	For 7	For 6	For 5	For 4	For 3	For 2	For 1	For 0
BYTE 1	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits 0-7)	7	6	5	4	3	2	1	0
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Fault mode enabling	DO Error_Mode bits	-	decimal system	0-255 (Default: 0)	The fault security state value of DQ0.x port is enabled, the binary bit bit corresponds to DQ0.x port (Bit 0 corresponds to DQ-0.0, and so on). When the module enters the fault safe state, if the "Error Mode" corresponds to bit bit of "1", the value of "Error Value [7..0]" corresponds to bit bit is output to the corresponding DQ0.x port.			
Fault value: Safety status value	DO Error_Value bits	-	decimal system	0-255 (Default: 0)	If the binary bit bit corresponding to the Error Mode [7..0] parameter is set to enable, the parameter value is output to the DQ port when the system enters a fault safe state.			

SRX-D1600-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Input the filter time (Filter)							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Input filter time	Filter	ms		0-255				
				(Default: 5)				

SRX-D0016X-MT parameter configuration definition

output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode
(DO Error_Mode bits 0-7)	For 7	For 6	For 5	For 4	For 3	For 2	For 1	For 0
BYTE 1	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits 0-7)	7	6	5	4	3	2	1	0
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Fault mode enabling	DO Error_Mode bits	-	decimal system	0-255 (Default: 0)	The fault security state value of DQ0.x port is enabled, the binary bit corresponds to DQ0.x port (Bit 0 corresponds to DQ-0.0, and so on). When the module enters the fault safe state, if the "Error Mode" corresponds to bit bit of "1", the value of "Error Value [7..0]" corresponds to bit bit is output to the corresponding DQ0.x port.			
Fault value: Safety status value	DO Error_Value bits	-	decimal system	0-255 (Default: 0)	If the binary bit corresponding to the Error Mode [7..0] parameter is set to enable, the parameter value is output to the DQ port when the system enters a fault safe state.			

SRX-D3200-MT configuration parameter definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Input the filter time (Filter)							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Input filter time	Filter	ms	decimal system	0-255				
				(Default: 5)				

SRX-D0032X-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode
(DO Error_Mode bits 0-7)	For 7	For 6	For 5	For 4	For 3	For 2	For 1	For 0
BYTE 1	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits 0-7)	7	6	5	4	3	2	1	0
BYTE 2	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode	DO Error_Mode
(DO Error_Mode bits 8-15)	For 15	For 14	For 13	For 12	For11	For 10	For 9	For 8
BYTE 3	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits 8-15)	15	14	13	12	11	10	9	8
.	16-31 See the above configuration							
.								
data-in:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Fault mode	DO	-	decimal	0-255	The fault security state value of DQ0.x port is enabled, the binary			

enabling	Error_Mode bits		system	(Default: 0)	bit bit corresponds to DQ0.x port (Bit 0 corresponds to DQ-0.0, and so on). When the module enters the fault safe state, if the "Error Mode" corresponds to bit bit of "1", the value of "Error Value [7..0]" corresponds to bit bit is output to the corresponding DQ0.x port.
Fault value: Safety status value	DO Error_Value bits	-	decimal system	0-255 (Default: 0)	If the binary bit bit corresponding to the Error Mode [7..0] parameter is set to enable, the parameter value is output to the DQ port when the system enters a fault safe state.

SRX-D1616X-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Input the filter time (Filter)							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Input filter time	Filter	ms	decimal system	0-255 (Default: 5)				
output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode
(DO Error_Mode bits 0-7)	For 7	For 6	For 5	For 4	For 3	For 2	For 1	For 0
BYTE 1	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits 0-7)	7	6	5	4	3	2	1	0
BYTE 2	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode	DO Error Mode
(DO Error_Mode bits 8-15)	For 15	For 14	For 13	For 12	For11	For 10	For 9	For 8
BYTE 3	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For	DO Error Value For
(DO Error_Value bits8-15)	15	14	13	12	11	10	9	8
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Fault mode enabling	DO Error_Mode bits	-	decimal system	0-255 (Default: 0)	The fault security state value of DQ0.x port is enabled, the binary bit bit corresponds to DQ0.x port (Bit 0 corresponds to DQ-0.0, and so on). When the module enters the fault safe state, if the "Error Mode" corresponds to bit bit of "1", the value of "Error Value [7..0]" corresponds to bit bit is output to the corresponding DQ0.x port.			
Fault value: Safety status value	DO Error_Value bits	-	decimal system	0-255 (Default: 0)	If the binary bit bit corresponding to the Error Mode [7..0] parameter is set to enable, the parameter value is output to the DO port when the system enters a fault safe state.			

SRX-A0600-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								
...	...							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Channel 1 measurement type	Measuring Range For CH1	-	symbol	0:Disable 1:0-10V (by default) 2:0-20ma 3:4-20ma	Select the corresponding simulation quantity into the range of it Disable Close of the sampling channel			
The frequency filter for the channel 1	Notch Filter For CH1	-	symbol	0:Disable 1:50Hz 2:60Hz	Filter the 50Hz or 60Hz power frequency clutter interference			
The number of sampling of channel 1	AverageNum For CH1	-	symbol	X0 (default) X4 X8 X16 X32	The module adopts the average algorithm, and adjusting this parameter can adjust the average depth, improve the sampling accuracy, but will reduce the response time			
Full-range engineering value of channel 1	Full value For CH1	-	symbol	-3276832767 (default 32767)	Engineering value of the maximum range			
Zero-range engineering value of channel 1	Zero_valueFor CH1	-	symbol	-32768... 32767 (default: 0)	Engineering value of the minimum range			

SRX-A1200-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								
...	...							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Channel 1 measurement type	Measuring Range For CH1	-	symbol	0:Disable 1:0-10V (by default) 2:0-20ma 3:4-20ma	Select the corresponding simulation quantity into the range of it Disable Close of the sampling channel			
The frequency filter for the channel 1	Notch Filter For CH1	-	symbol	0:Disable 1:50Hz 2:60Hz	Filter the 50Hz or 60Hz power frequency clutter interference			
The number of sampling of channel 1	AverageNum For CH1	-	symbol	X0 (default) X4 X8 X16 X32	The module adopts the average algorithm, and adjusting this parameter can adjust the average depth, improve the sampling accuracy, but will reduce the response time			
Full-range engineering value of channel 1	Full value For CH1	-	symbol	-3276832767 (default 32767)	Engineering value of the maximum range			
Zero-range engineering value of channel 1	Zero_valueFor CH1	-	symbol	-32768... 32767 (default: 0)	Engineering value of the minimum range			

SRX-A0004-MT parameter configuration definition

output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								
...	...							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Channel 1 measurement type	Measuring Range For CH1	-	symbol	0:Disable 1:0-10V (by default) 2:0-20ma 3:4-20ma	Select the corresponding simulation quantity into the range of it Disable Close of the sampling channel			
The frequency filter for the channel 1	Notch Filter For CH1	-	symbol	0:Disable 1:50Hz 2:60Hz	Filter the 50Hz or 60Hz power frequency clutter interference			
The number of sampling of channel 1	AverageNum For CH1	-	symbol	X0 (default) X4 X8 X16 X32	The module adopts the average algorithm, and adjusting this parameter can adjust the average depth, improve the sampling accuracy, but will reduce the response time			
Full-range engineering value of channel 1	Full value For CH1	-	symbol	-32768..32767 (default 32767)	Engineering value of the maximum range			
Zero-range engineering value of channel 1	Zero_valueFor CH1	-	symbol	-32768... 32767 (default: 0)	Engineering value of the minimum range			

SRX-A0008-MT parameter configuration definition

output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								
...	...							
data specification:								
The parameter name		unit	form	input range	explain			
the Chinese language	English							
Channel 1 measurement type	Measuring Range For CH1	-	symbol	0:Disable 1:0-10V (by default) 2:0-20ma 3:4-20ma	Select the corresponding simulation quantity into the range of it Disable Close of the sampling channel			
The frequency filter for the channel 1	Notch Filter For CH1	-	symbol	0:Disable 1:50Hz 2:60Hz	Filter the 50Hz or 60Hz power frequency clutter interference			
The number of sampling of channel 1	AverageNum For CH1	-	symbol	X0 (default) X4 X8 X16 X32	The module adopts the average algorithm, and adjusting this parameter can adjust the average depth, improve the sampling accuracy, but will reduce the response time			
Full-range engineering value of channel 1	Full value For CH1	-	symbol	-32768..32767 (default 32767)	Engineering value of the maximum range			
Zero-range engineering value of channel 1	Zero_valueFor CH1	-	symbol	-32768... 32767 (default: 0)	Engineering value of the minimum range			

SRX-A0604-MT parameter configuration definition

data-in								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								

...

output data								
BIT No	BIT 7	BIT 6	BIT 5	BIT 4	BIT 3	BIT 2	BIT 1	BIT 0
BYTE 0	Measuring Range For CH1							
BYTE 1	Notch Filter For CH1							
BYTE 2	AverageNum For CH1							
BYTE 3	Full value For CH1							
BYTE 4								
BYTE 5	Zero_valueFor CH1							
BYTE 6								
BYTE 7	Measuring Range For CH2							
BYTE 8	Notch Filter For CH2							
BYTE 9	AverageNum For CH2							
BYTE 10	Full value For CH2							
BYTE 11								
BYTE 12	Zero_valueFor CH2							
BYTE 13								
...								

data specification:

The parameter name		unit	form	input range	explain
the Chinese language	English				
Channel 1 measurement type	Measuring Range For CH1	-	symbol	0:Disable 1:0-10V (by default) 2:0-20ma 3:4-20ma	Select the corresponding simulation quantity into the range of it Disable Close of the sampling channel
The frequency filter for the channel 1	Notch Filter For CH1	-	symbol	0:Disable 1:50Hz 2:60Hz	Filter the 50Hz or 60Hz power frequency clutter interference
The number of sampling of channel 1	AverageNum For CH1	-	symbol	X0 (default) X4 X8 X16 X32	The module adopts the average algorithm, and adjusting this parameter can adjust the average depth, improve the sampling accuracy, but will reduce the response time
Full-range engineering value of channel 1	Full value For CH1	-	symbol	-32768..32767 (default 32767)	Engineering value of the maximum range
Zero-range engineering value of channel 1	Zero_valueFor CH1	-	symbol	-32768... 32767 (default: 0)	Engineering value of the minimum range

★The functions of other mixed modules are all combinations of the functions of the above modules. The parameters can correspond to and refer to the above-mentioned materials.

For example, for SRX-M8860P-MT, the parameters can be referred to those of SRX-D0808P-MT and SRX-A0600-MT.



6.Communication connection with PLC

Please go to the official website to download the communication settings file for the corresponding PLC and SRX-MT. www.latcos.cn

Official website



先进自动化控制及工业网络技术



Copyright © 2023 Wuxi Latcos Automation Technology, Inc. All rights reserved.

Wuxi Lingke Automation Technology Co., Ltd. www.latcos.cn

Company Tel: **0510-85888030**